



User's manual



Pressurized enclosure system F850S

safety standard SIL 2

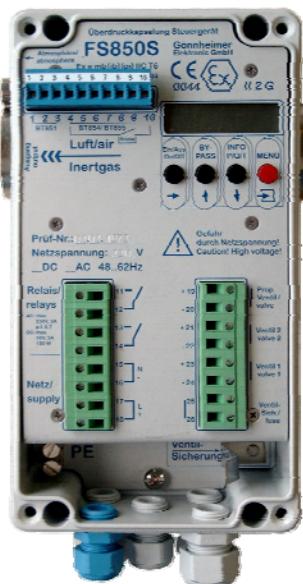

Software version 3.3.2 - manual rev.7

☞ Contents

1 OPERATION INSTRUCTION FOR EXPLOSION PROTECTED DEVICE.....	4
2 INTRODUCTION: PRESSURIZED ENCLOSURE SYSTEM F850S	5
2.1 Explosion protection: pressurized enclosure	5
2.2 Pressurized enclosure system with safety standard SIL 2	5
2.3 Pressurized enclosure system F850S.....	5
2.3.1 Mode pressurization using leakage compensation	5
2.3.2 Mode pressurization using Continuous flow.....	7
2.3.3 F850S -Application using „Containment Systems“.....	7
2.4 Peripherals.....	7
2.4.1 Operating panels	7
2.4.2 Common operating panels: BT 854.1 and BT 855.1.....	7
2.4.3 Intelligent operating panel type BT 851.....	7
2.4.4 Disconnector unit SR852 and SR853	8
2.5 Special demands in operation zone 21 (Dust)	8
2.5.1 Purging period -> cleaning period: cleaning the housing inside	8
2.5.2 Additional marking	8
2.6 Additional information: EC- type certificate F850-SYST.....	9
2.7 Conformity with standards	9
2.8 Transport, Storing, Disposal and Repairs	9
2.8.1 Repair of the control device.....	9
3 INSTALLATION AND CONNECTION.....	10
3.1 Mounting	10
3.1.1 Control unit FS 850S	10
3.1.2 Solenoid valves	10
3.1.3 Purge gas supply	11
3.1.4 Operating panels BT 8xx.x	11
3.1.5 Disconnector units SR852 / SR853.....	11
3.2 Connecting and Commissioning	11
3.2.1 Connection details	12
3.2.2 Terminal description FS 850S	13
3.2.3 Power off relays.....	13
3.2.4 Commissioning and parameter defaults.....	14
3.2.5 Purging process.....	14
3.3 Maintenance	14
4 OPERATION	16
4.1 Human interface	16
4.1.1 Display	16
4.1.2 Keyboard	16
4.2 How to enter and leave the bypass mode	17
4.3 Indications during normal operation	18
4.4 Configuration	18
4.4.1 The menu structure	18
4.4.2 Description of the menu items.....	19
4.4.3 Configuration Example	21
4.5 Alarm and malfunction indications	23
5 FLOW CHARTS.....	24
6 APPENDIX	29
6.1 Tables	29
6.2 Type code	29
6.3 Technical Details	31
6.4 Marking	31

6.5	Block diagrams	32
6.6	Dimensions	33
6.7	Sequence of operation diagram	34
6.8	List of Parameters.....	35
7	ADDITIONS/CHANGES OF THE MANUAL FOR F850S	36
7.1	Ergänzungen / Änderungen zu Softwareversion 9.7.4.....	36
7.2	Additions/changes of the manual for F850S, option: Decrease of pressure signal alarm	37
7.3	Additions/changes of the manual for F850S, option: bypass monitor	37

The symbols WARNING, CAUTION, NOTE

 Warning	This symbol warns of a serious hazard. Failure to observe this warning may result in death or the destruction of property.
 Caution	This symbol warns of a possible failure. Failure to observe this caution may result in the total failure of the device or the system or plant to which it is connected.
 Note	This symbol highlights important information.

Safety Measures: to read and to comply

 Warning	<p>Warning! Extreme caution is advised when handling this device. High electrical discharge is possible and can be fatal.</p> <p>Work on electrical installations and apparatus in operation is generally forbidden in hazardous locations, with the exception of intrinsically safe circuits. In special cases work can be done on non-intrinsically safe circuits, on the condition that during the duration of such work no explosive atmosphere exists.</p> <p>Only explosion protected certified measuring instruments may be used to ensure that the apparatus is voltage-free. Grounding and short-circuiting may only be carried out, if there is no explosion hazard at the grounding or short circuit connection.</p>
---	---

1 Operation instruction for Explosion protected device

Application and Standards

This instruction manual applies to explosion-protected devices of types below. This apparatus is only to be used as defined and meets requirements of EN 60 079 particularly EN60 079-14 "electrical apparatus for potentially explosive atmospheres".

Use this manual in hazardous locations, which are hazardous due to gases and vapours according to the explosion group and temperature class as stipulated on the type label. When installing and operating the explosion protected distribution and control panels you should observe the respective nationally valid regulations and requirements.

General Instructions

Work on electrical installations and apparatus in operation is generally forbidden in hazardous locations, with the exception of intrinsically safe circuits. In special cases work can be done on non-intrinsically safe circuits, on the condition that during the duration of such work no explosive atmosphere exists.

Only explosion protected certified measuring instruments may be used to ensure that the apparatus is voltage-free. Grounding and short-circuiting may only be carried out, if there is no explosion hazard at the grounding or short circuit connection.

To achieve an impeccable and safety device operation, please take care for adept transportation, storage and mounting, as well as accurate service and maintenance. Operation of this device should only be implemented by authorised persons and in strict accordance with local safety standards.

The electrical data on the type label and if applicable, the "special conditions" of the test certificate BVS 06 ATEX E 088are to be observed.

For outdoor installation it is recommended to protect the explosion protected distribution and control panel against direct climatic influence, e.g. with a protective roof. The maximum ambient temperature is 40°C, if not stipulated otherwise.

Terminal compartment in Increased Safety

When closing, it is to be ensured that the gaskets of the terminal compartment remain effective, thus maintaining degree of protection IP 54 according to EN 60529. Close unused entries by impact-proof stopping plugs, which are secured against self-loosening and turning.

Do not open the device in Ex area, as long the device is energized.

Inside area with explosive dust do clean the inner of the housing of the dust before closing the housing.

Maintenance Work

The gaskets of Ex e enclosures are to be checked for damages and replaced, if required. Terminals, especially in the Ex e chamber are to be tightened. Possible changes in colour point to increased temperature. Cable glands, stopping plugs and flanges are to be tested for tightness and secure fitting.

Intrinsically Safe Circuits

Erection instructions in the testing certificates of intrinsically safe apparatus are to be observed. The electrical safety values stipulated on the type label must not be exceeded in the intrinsically safe circuit. When interconnecting intrinsically safe circuits it is to be tested, whether a voltage and/or current addition occurs. The intrinsic safety of interconnected circuits is to be ensured. (EN 60079-14, section 12)

2 Introduction: Pressurized enclosure system F850S

2.1 Explosion protection: pressurized enclosure

The use of pressurized enclosures allows the operation of 'non explosion protected' devices in hazardous areas inside zone 1 and zone 2. The protection type 'pressurisation' is based on the principle of maintaining a constant pressure using air or a protective gas to prevent an explosive mixture forming near the device inside the pressurized enclosure.

Before start-up, the pressurized enclosure must be purged with air or protective gas to remove any explosive mixture that may be inside the enclosure.

2.2 Pressurized enclosure system with safety standard SIL 2

Since the second issue of the norm EN 50016 (pressurized enclosure "p", 05.1996) Ex p- control devices are declared as security devices.

At that time the notified bodies (PTB, EXAM, TÜV Nord, etc.) demanded that the Ex p- control devices must fulfil the category 3 of EN 954-1. This demand was also taken over into the standards EN 60079.

After the replacement of EN 954-1 by the norms IEC / DIN EN 61508-1 and-2, respectively DIN EN ISO 13849-1 and-2 and DIN EN 50495 a security level by at least SIL 2 is demanded to a pressurized enclosure system to EN 60079-2. This should be seen as an informal understanding between the German notified bodies.

Therefore the pressurized enclosure system F850S with Ex p- control device FS850S was tested by the 3rd amendment of the EC- type certificate (BVS 06 ATEX E 086) with the result:

SIL Level 2.

2.3 Pressurized enclosure system F850S

The pressurized enclosure system F850S contains at least the control unit FS 850S and a solenoid valve. Each can be mounted in- or outside the enclosure. Furthermore several remote controls (operation panels) are available to improve ease of operation. It is also possible to connect intrinsically safe sensors to the control unit FS 850S.

The pressurized enclosure system F850S operates in two different modes: Pressurization using leakage compensation and Pressurization using continuous flow of protective gas.

2.3.1 Mode pressurization using leakage compensation

After purging, the control unit FS 850S holds the pressure inside the enclosure at a minimum of 0,8 mbar. Two different solenoid vale techniques are available: digital working solenoid valve (DSV) technique or proportional working solenoid valve (PSV) technique.

a) Digital solenoid valve technique

While purging, the DSV is activated and a large amount of purge medium flows inside the enclosure through a nozzle with a large cross-section. After purging, the control unit turns off the DSV. The leakage compensation is made by a bypass choke, with a very small adjustable cross-section (diameter 0,3 ...1 mm), inside the valve. The protective medium that flows into the enclosure now is adequate to maintain a pressure of at least 0,8 mbar. The pressure is monitored by the control unit FS 850S. The maximum and minimum pressure of the enclosure is programmable.

For purging, a traditional and a new integrating method are available:

1. Using the traditional method the purge quantity is a product of a pre-set minimum of flow rate and time. The flow rate depends on the size of the internal nozzle (diameter 1 ...6 mm)

of the valve and can be specified by matched charts. The common rule of purging must be considered: let in minus leakage loss is bigger than flow minimum. This purging method is called as **time based purging method**.

2. In contrast to the traditional one the **integrating purging method** measures the real volume flow through the enclosure outlet and adds it up to get the real purge volume. Also, the flow rate is monitored, depending on the size of the plate orifice of the control unit. If the flow rate sinks below its minimum, it will be ignored and it will not contribute to volume integration. Therefore we achieve a safe and economical purging method. See also Figure_1.

Pressure inside the enclosure will be observed by each purging method.

The digital solenoid valve technique has a considerable disadvantage: during purging process and normal operation, a constant rate of protective gas is needed. For safety reasons the rate must be larger than leakage rate of the enclosure. Wasting protective gas causes high costs in many applications.

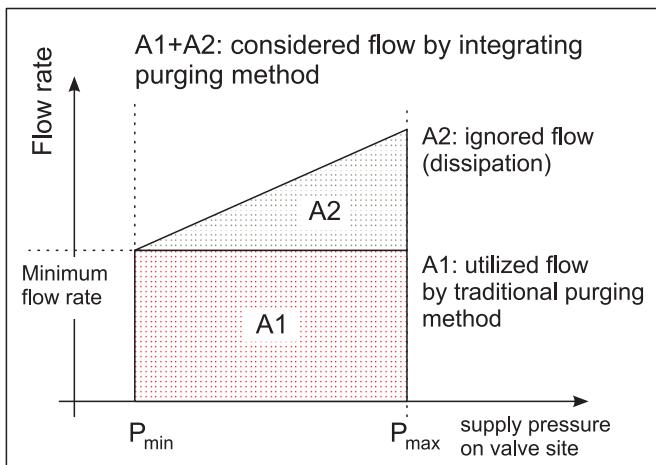


Figure 1: Consumption of protective gas

b) Proportional solenoid valve technique

Using proportional solenoid valve technique prevents unnecessary wasting protective gas. The internal proportional working sensory equipment and a proportional valve as actuator are combined to a **pressure feedback control system**.

The benefits of pressure feedback control are:

1. Considerable less consumption of protective gas - additional costs for proportional valve will be amortised soon
2. Increased service reliability achieved by constant pressure inside enclosure - increasing leakage caused by e.g. ageing of the enclosure will be balanced and sudden failure is prevented
3. Almost no flow noise and only a small protective gas consumption using a solid enclosure

Another advantage using a proportional solenoid valve is; that pressure control is also used during purging. A set-point pressure will be achieved in the enclosure, while the flow volume, that leaves the enclosure, will be recorded and integrated through time, until the required purge volume is achieved. Advantages of this method are:

1. A definite pressure while purging - pressure sensitive parts of the enclosure, like membrane switch panels or windows, will not be overloaded.
2. Purge volume accuracy is achieved by integration of the purge medium flow volume at the outlet. Wasting purge medium is no more a topic of today.

2.3.2 Mode pressurization using Continuous flow

The control unit FS 850S incorporates the operation mode „continuous flow“. This operation mode is necessary, for example if an analyser produces an explosive atmosphere inside the enclosure (containment system). The operation mode continuous flow flushes the enclosure permanently. After the (pre-) purging procedure (purging process) a set-point flow rate is adjusted during normal operation. The monitored flow rate minimum is adjustable. The continuous flow operation mode can be realised using 2 digital solenoid valves as well as using one proportional solenoid valve.

2.3.3 F850S -Application using „Containment Systems“

„Containment Systems“ are defined as parts of a device within a pressurized enclosure, which could emit combustible gas (or occasionally an explosive environment: zone 1, explosive mixture) from within the enclosure.

In order to receive an Ex p-System including a „Containment System“, which is failsafe according EN 50016, with the attribute 'no emission', the following conditions must be met:

1. The flammable substance inside the containment system is in the gas or vapour phase when operating between the specified temperature limits
2. The minimum pressure specified for pressurized enclosure is at least 50 Pa higher than the maximum pressure specified for the containment system
3. An automatic safety device initiates, if the pressure difference falls below 50 Pa.

This automatic safety device can be activated by a difference pressure switch, looped into the external alarm loop (terminal 4/10 on FS 850S). If an alarm occurs on this loop, the control device FS 850S will turn off the ignition-capable device immediately. After alarm cancelling the control device FS 850S starts operation automatically with the purging procedure. The external alarm loop is made by a normal closed connection method.

2.4 Peripherals

2.4.1 Operating panels

For the control unit FS 850S several operating and visualising panels are available. These panels consist of the explosion protection class 'intrinsically safe' and are considerably advantageous, particularly when the control unit is mounted inside the enclosure.

2.4.2 Common operating panels: BT 854.1 and BT 855.1

The operator panels BT854.x and BT855.x are simple group of pure passive (according to EN 60079-11) simple electrical devices, which can be operated without an extra certification only in line to an intrinsically safe circuit. Connect the common operator panels to the certified Exi circuits on the control unit FS850S. Therefore they are not explicit listed on the EC certificate BVS 06 ATEX E 088 of the FS850S.

The common operator panels have the following features:

- On/Off-Switch
- Key-operated switch for bypass
- LED-indicator for READY and ON

The connection to the control unit consists of 6 wires.

2.4.3 Intelligent operating panel type BT 851

This operation panel indicates operation and malfunction reports as plain text. The 4 membrane switches offer total command of the control unit. Status, momentary pressure, flow rate as well as remaining purge time are always available.

The connection to the control unit consists of only 3 wires.

Alarm signal lamp on BT851

The red alarm signal lamp (LED) is just below the Display. The lamp is blinking, if the pressure inside of the cabinet is below the programmed minimum pressure. The lamp is continuously on while the FS850S is switched into BYPASS mode. In normal operation the alarm signal lamp is dark.

2.4.4 Disconnector unit SR852 and SR853

According to EN 60079-2 all non- intrinsically safe connections of the ignition capable apparatus must be disconnect, if the protection gas pressure falls below the safety limit. In many applications more than the two connector terminals on the control unit FS850S are needed.

In these cases the disconnector unit SR852 provides 8 respectively 16 galvanically separated connectors to separate the additional non- intrinsically safe lines.

The SR853 is available for an line separation with higher switch capacity (400 V, 16A).

2.5 Special demands in operation zone 21 (Dust)

2.5.1 Purging period -> cleaning period: cleaning the housing inside

In zone 21 the housing **must not** be purged in comparison to the operation in gas zone 1. The operator has to insert the purging volume zero "0 [l]" into the parameter menu.

Purging in the presence of combustible dust would generate a dangerous explosive atmosphere inside the cabinet.

In the zone 21 the purging period is replaced by a cleaning period, viz. the operator has to remove thoroughly the combustible dust inside before he is energizing the electrical parts inside the cabinet.

After cleaning the pressure inside of the cabinet prevent an infiltration of dust.

2.5.2 Additional marking

The cabinet must contain a well viewable sign with the following content:

„WARNING: REMOVE ALL DUST FROM THE INSIDE OF THE ENCLOSURE BEFORE CONNECTING OR RESTORING THE ELECTRICAL SUPPLY“

On Ex p cabinets suitable for zone 21, which can be opened without tools, has to be placed the following mark:

„WARNING: DO NOT OPEN WHILE ENERGIZED UNLESS IT IS OBVIOUS THAT NO COMBUSTIBLE DUST IS PRESENT“

2.6 Additional information: EC-type certificate F850-SYST

Gönnheimer features as manufacturer of Ex p- Systems a comprehensive ATEX Ex p- SYSTEM Certification of a notified body.

Provides a economical solution for small quantities

- certified for Ex- Zone 1
- enhanced for Dust- Ex, Zone 21 (category 2D)
- the first ATEX certification of this type in Europe
- matches > 80% of all individual customer systems
- enhanced pressure ranges: 27mbar, 350mbar and 1 bar

Customer advantages:

+ usual delivery time, + usual quality, + usual costs, + no additional efforts

2.7 Conformity with standards

The explosion proof device type FS850S meets requirements of listed standards in the attachment (Declaration of conformity). They were developed, manufactured and tested in accordance with state-of-the-art engineering practice and ISO9001:2008.

2.8 Transport, Storing, Disposal and Repairs

Transport	Vibration-free in origin package, do not drop, handle carefully
Storing	Store the device dry, inside of the origin package
Disposal	When the explosion proof multipurpose distribution, switching and control units are eventually disposed of, the national regulations governing the disposal of waste materials in the country concerned must be rigorously observed.
Repairs	Defective parts may only be replaced by the Manufacturer or by personnel specially trained and supervised by the Manufacturer. Only genuine spare parts from the Manufacturer may be fitted.

2.8.1 Repair of the control device

Only Gönnheimer Elektronic GmbH should proceed repairs on the pressurized enclosure system.

3 Installation and connection

This Chapter contains important steps for mounting, connecting and starting.

3.1 Mounting

3.1.1 Control unit FS 850S

The control unit FS 850S can be placed inside a hazardous area. The location (inside or outside the enclosure) as well as the position is almost arbitrary. Only intake and outlet of the control unit should be lined up on a horizontal axis. See also Figure 12 in the Appendix.

The control unit has 4 holes on the rear plate for mounting, although fixing only with the screw connection of intake or outlet is sufficient.



Caution


Observe local safety guidelines and the regulative DIN EN 60079-14.



Caution


The reference input (M5 threat on the left side of the housing FS850S) must have ambient pressure level.

If the location of the control device FS850S is inside the Ex p cabinet, the preference input must be connected with a small pipe to ambient pressure level.



Note

The solenoid valve(s) and the control unit (respectively pressure monitor) should be mounted on the enclosure as far away from each other as possible (E.g. space diagonal arrangement), to achieve a total purging.



Note

**The inner diameter of a pipe connected to the air in- or outlet of the FS850S must be one and a half time (1,5 x) bigger than the orifice plate inside of the FS850S.
Keep the air pipes as short as possible**

Particle barrier

The control device is equipped with a particle barrier according to EN 60079-2. Hence, the purge gas flow on the outlet of the control device can be stream directly into the Ex zone.

3.1.2 Solenoid valves

The solenoid valves can be mounted inside or outside the enclosure. For mounting position see manufacturer's guide.

3.1.3 Purge gas supply

Important items:

Quality	Instrument air, rep. Inert gas pressured air class 533 according to ISO 8573-1 = particle 40µm (class 5) / dew-point -20°C (class 3) / oil 1 mg/m³ (class 3) according to the demands of the build-in devices inside the cabinet, the air quality should be better
Supply pressure	If not differently given 2 ..4 bar
Purge gas pipes length	According to diameter of the supply pipe big pressure losses arise during the pre purge phase (high flow rate). The following items are to be considered by choosing the right purge gas pipe. Reference values: At a pipe diameter of 4 mm (inner diameter) and a flow rate of 2 liters/sec. generates a pressure loss of 500 mbars per meter . The pressure losses causes lower purge gas flow rate and result into longer or never ending pre purge period.

3.1.4 Operating panels BT 8xx.x

⇒ Operating panel BT 851.0

The Operating panel BT 851.0 is mounted, without rear plate, directly on the enclosure. For mounting and bushing of the wire, several holes must be made. For location and drill size see Figure 13: Dimensions and template BT 851 in appendix.

⇒ Operating panel BT 851.5

The operating panel BT 851.5 has housing with environment protection IP 65. It can be located anywhere in hazardous area zone 1. For location and drill size see Figure 13: Dimensions and template in appendix.

⇒ Operating panel BT 854.x

The operating manual BT 854.x consists only of 2 LEDs and an ON/OFF-switch, directly fixed on the enclosure. The BT 854.1 has an additional key-operated switch for bypass. For location and drill size see Figure 14: Dimensions BT 855, template BT 854 in appendix.

⇒ Operating panel BT 855.x

The operating panel BT 855.5 has housing with environment protection IP 65. It can be located anywhere in hazardous area zone 1. For location and drill size see Figure 14: Dimensions BT 855, template BT 854 in appendix.

3.1.5 Disconnector units SR852 / SR853

The disconnector unit SR852 / SR853 can be mounted and operated in hazardous area zone 1. It represents an Ex-e terminal box.

3.2 Connecting and Commissioning

After mounting, connect the 'intrinsically safe' peripherals to terminal 1-10, and the power supply, valves and ignition-capable apparatus to increased safety terminals of the control unit.

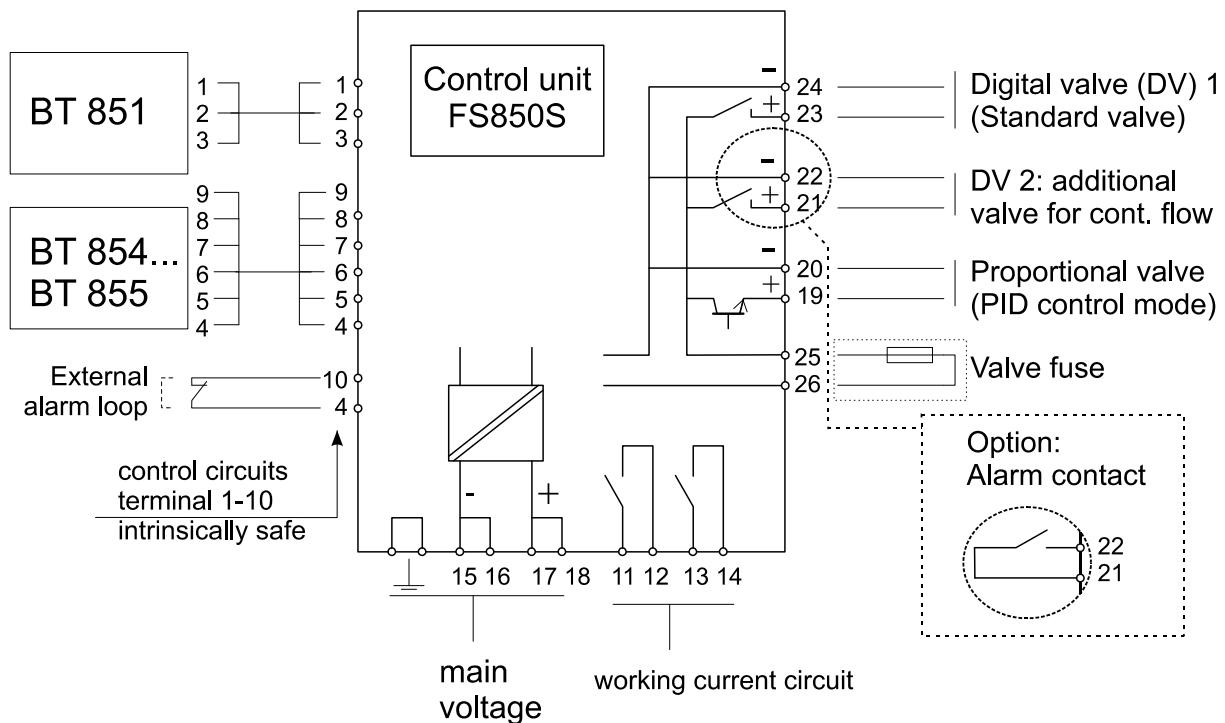


Figure 2: Block diagram FS850S

3.2.1 Connection details

Please obey the following limits

Min. and max. clamping torque	min. 0,3 Nm max. 0,4 Nm
Min. und Max. wire cross- section	steep: 0,2 – 2,5 mm ² flexible: 0,2 – 2,5 mm ²



LINE VOLTAGE !

Extreme caution is advised when handling this device.
High electrical discharge is possible and can be fatal.

Warning



Please note the following Standard of Compliance:
BVS 06 ATEX E 088 and the regulative DIN EN 60079-14.

Caution

Do not exceed terminal safety limits of each terminal.
See limits in technical details or declarations of conformity.

The solenoid valve fuse value must match the used solenoid valve type

3.2.2 Terminal description FS 850S

Terminal		Description
FS850S	BT 85x SR 852	
1	1	
2	2	Terminals exclusively for connecting the operating panel BT 851
3	3	
4	4	
5	5	
6	6	Terminals of operating panel BT 813, BT 814 and BT 815
7	7	
8	8	
9	9	
4		External alarm loop (intrinsically safe), opening circuit alarms Ex p-System
10		and switching off ignition-capable device.
11,12		Working current circuit 1
13,14		Working current circuit 2
15,16 -		Line voltage, either neutral conductor at AC or minus pole at DC
17,18 +		Line voltage, either outer conductor at AC or plus pole at DC
19,20 +,-		Terminals for proportional solenoid valve
21,22 +,-		Terminals for additional solenoid valve 2 respective signal pressure alarm (Option: FS850S.x.x.1)
23,24 +,-		Terminals for digital solenoid valve 1
25,26		Terminals for solenoid valve fuse inside FS 850S



Note

If the BT854.1 or BT855.1 operator panel is being used, the bypass function can be activated via an external key switch. In this case set the bypass code to 9999 to prevent a secondary bypass function by bypass code directly from the control unit. The key switch is to be connected to terminals 4 and 5 of the control unit.

If external operation panels BT 81x or additional pressure monitor are not used, it is possible to connect terminal 4 and 6 of the control unit FS850S to a shorting bridge, to enable an automatic switch after purging process.

In this case, the On/Off-function of the far left button on the control unit FS 850S is non- operational.

3.2.3 Power off relays



Warning

The maximum current limits (5 A) on the clamps 11,12 and 13,14 should not be exceeded at any time!

E.G. By an application of switched power supply a multiple higher current as the nominal max. current may occur. In this case a switching on current limitation (e.g., NTC) must be added to avoid the off-limits high current. If this is missed the risk of welded relay contacts and within the loss of the explosion protection exists!!

3.2.4 Commissioning and parameter defaults

The following parameters are pre-set after connecting the FS850S to mains supply:

	Parameter	Display	Text	Comment
Structure	Mode: leakage compensation Purging method: time based Type of valve: proportional			
Codes	Main menu (M-Code) Bypass (By-Code) On/Off-Code (On/Off-C.)	0001 0002 0000		The setting 0000 disables the coding (not in the case of M code) The setting 9999 switches off bypass by coding
Pressure and flow	Purging time Purging volume Min. flow while purging Min. flow while operating Flow set-point Min. pressure inside enclosure Max. press. inside enclosure Set-point press. while purging Set-point press. while operating	00-10-00 500.0 0.9 0.5 2.0 0.8 15.0 10.0 2.0	10 [min] 500.0 [l] 0.9 [l/s] 0.5 [l/s] 2.0 [l/s] 0.8 [mbar] 15.0 [mbar] 10.0 [mbar] 2.0 [mbar]	time based purging method selected integ. purging method selected time based purging meth. selected operation mode continuous flow selected proportional solenoid valve selected



Note

Triggering the Reset
Press red bottom (*ENTER-Button*)* while switching on the control unit FS 850S to reset all parameters to the values in table above.

*: used only on control unit FS 850S.

3.2.5 Purging process

The control unit FS 850S starts the purging process immediately after start up, providing the programmed minimal pressure (minimum 0.8 mbar) is present. Parallel to pressure monitoring, the flow rate will be watched, to get a safe purging process.

If the purging flow rate passes its minimum (e.g. temporary shut at the outlet), then the purging process will be interrupted and the control unit continues purging, after the disturbance is gone. But if purging pressure exceeds the min or max limits then the purging process will be terminated and the control unit will start a new purging process automatically after achieving purging condition.

The table below shows the minimum flow rate in accordance of the used plate orifice.

Plate orifice in control unit	Minimum flow rate
Ø = 4 mm	0,07 liter /sec.
Ø = 6 mm	0,15 liter/sec.
Ø = 10 mm	0,35 liter/sec.
Ø = 14 mm	0,85 liter/sec.
Ø = 18 mm	1,25 liter/sec.

3.3 Maintenance

Purge gas pipe system

Depending upon purity of the assigned purging air the inlet and outlet opening of the FS850S must regularly be examined on impurities (e.g. oil, dust, etc) or corrosion. In case of serious impurities the

operator should weigh the possibility of a punctual appropriate cleaning by Gönnheimer Elektronic GmbH in relation to a spontaneous loss of the controller.

Test of the power supply disconnection

In the maintenance interval the function of the power supply disconnection of the control device FS850S must be tested:

Turn off power supply of the control device (switched off).

Measure the status of the relay contacts terminals (11-12 and 13-14): **no contact**

If a relay contact (connecting terminal 11-12 or 13-14), nevertheless, remain closed, the control device is immediately to be exchanged, because it cannot fulfil ex protecting function (i.e. switching of the non ex- devices in the Ex p cabinet) any more.

Maintenance cycle

Maintenance cycle: at least all 3 years

4 Operation

4.1 Human interface

The user has total control of the purging system F850S by the use of 4 keys on the control unit FS850S respectively by using the external operating panel BT851. Operation on control unit FS850S panel BT851 is equal. Using the other operating panels only a restricted operation is possible.

4.1.1 Display

The built-in display indicates operation modes, present pressure or flow rate data, as well as malfunction.

4.1.2 Keyboard

The four multi-functional keys have different meanings and functions depend on the present operation mode.

Key	Mode	Function
Ein/Aus 	normal operation	Toggles the ignition-capable device on and off, if purging system state is ready
„Shift right“-button	running menu	Shift cursor one position right.
BYPASS 	normal operation	Activates Bypass. Caution  Fire certificate required !
INFO /P/Q/T 	running menu normal operation	Get menu next item Changes indication of the display: present pressure, flow rate, remaining purge time respectively purge volume and present state of the purging system
„Down“-button	running menu	Get previous menu item
MENU 	normal operation	Executes main menu
„Enter“-button	running menu	Initiates and confirms parameter input

4.2 How to enter and leave the bypass mode



Caution



Caution



The origin state is normal operation, the Ex p housing can be purged, un-purged or while purging. The steps shown below are according to the control device FS850 not to the operation panel BI851.x.

If you have a operation panel BT81x.1 use the key switch instead.

By-CODE

The bypass code is needed

0002

The ex works Bypass code is '0002'.



Enter is right code using the arrow keys and confirm with the *ENTER*- key.

Bypass

The bypass mode is now active.

Or

If the control unit is set to "automatic on" the display shows "bypass" and "On" alternately and the relay contacts (Ter. 11,12 and 13,14) are closed.

On



Now you can toggle the relay contacts by pressing the "right-" button. Remark: if the E/A- code is unequal to zero, you must enter them each time you want to change the relay contacts state.



Note

Leave the bypass mode in the same way as entered.

4.3 Indications during normal operation

The info-indication shows the present state of the purging system. In addition to this indication, it is possible to select current pressure-, flow rate-, or remaining purge time- indication. See below:

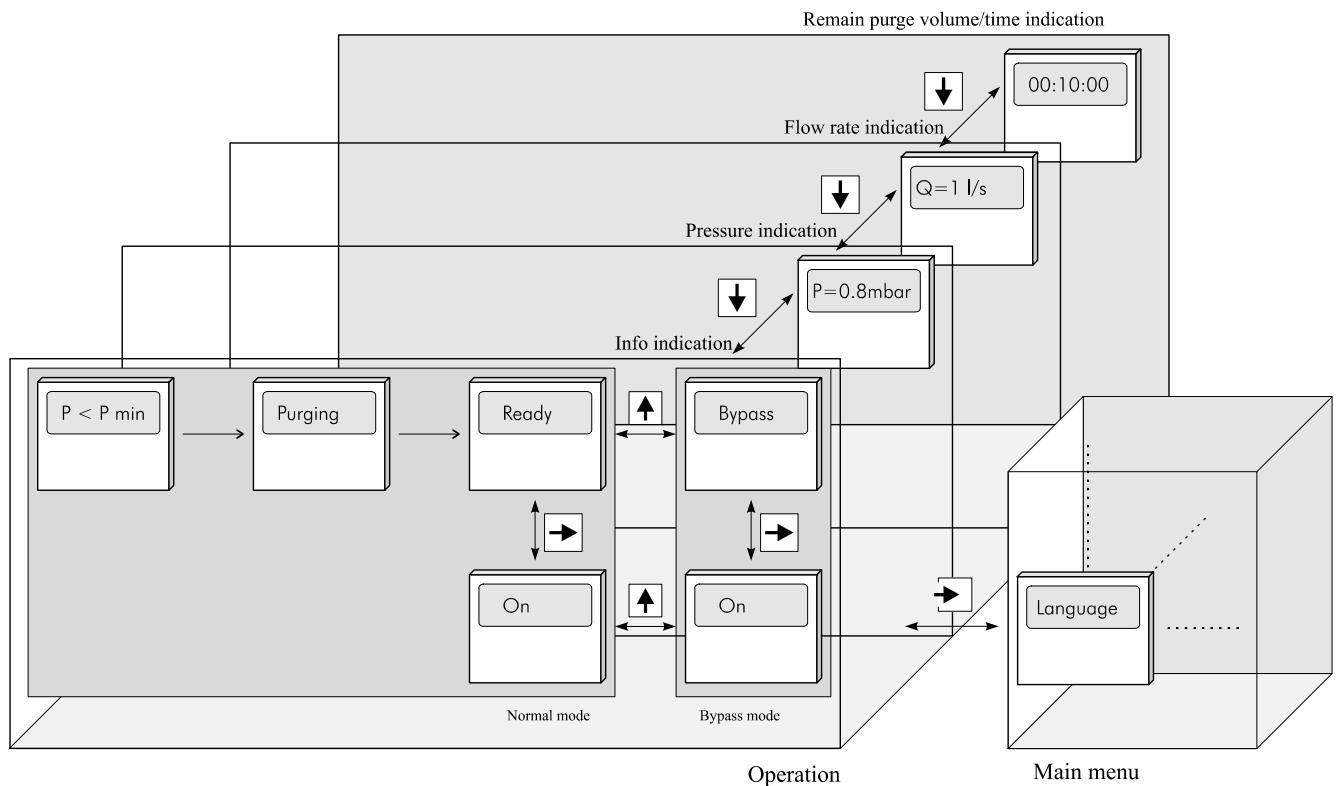


Figure 3 Flow chart: state of purging system and corresponding display

4.4 Configuration

You must configure and enter the parameters of the control unit FS850S to achieve a desired mode of operation. All parameters of the control unit are structured in form of a menu. See also the flow charts in chapter 5.

4.4.1 The menu structure

Main menu

The main menu is sub-divided into 4 separate categories:

- Language
- Structure
- Parameters
- Codes

Language

These are the 5 languages available:

- German
- English
- French
- Dutch
- Spanish

Structure

Selecting a purging system structure with the following alternatives:

- Operation mode leakage compensation or continuous flow
- Using digital or proportional solenoid valves
- Integration or time based purging method
- Using an additional pressure monitor
- Using the disconnector unit SR852

Parameters This category contains the necessary parameters depending on the structure defined above. Examples for parameters are:

- Purging time
- Minimum flow while purging process
- Minimum pressure
- Maximum pressure

Codes The control unit has 3 different code words:

- M-Code: to enter main menu
- By-Code: to activate Bypass
- E/A-Code: to switch ignition-capable apparatus on or off



The FS850S does not work while the main menu is active. - That means the solenoid valves and the ignition capable device inside the cabinet are switched off.

Note

4.4.2 Description of the menu items

The display of the control unit has only 8 digits. For this purpose the names of the structures and parameters are often abbreviations.

In the following table below are some explanations of the menu items. The table as a reference guide for programming the desired system structure and to set the appropriate parameters correctly. The menu items are roughly sorted by class.

Please note that the viewable conditions of parameters are not included. The category 'Language' is also excluded, because of its simplicity.

See also the corresponding flow charts in section 5.

Hierarchy			Description, Explanation
1.Level	2.Level	3.Level	
Structure	Valves	P-Valve	Selecting 'valves' on level 2 means that a proportional solenoid valve or a digital solenoid valve is available on level 3
		D-Valve	
Integra.	Integ. Y		Integration purging method, Yes Configures integration purging method.
	Integ. N.		Integration Purging method, No Selects time based purging method.
Cont.Flow	C. Flow Y.		Continuous Flow, Yes Activates the operation mode 'continuous flow'.
	C. Flow N.		Continuous Flow, No Activates the operation mode 'leakage compensation'.
Param.	Pur. Time	Purge time - Enter a fixed purge time in h/min/sec. The purge time only appears, if the time based purging method is chosen.


Pur. Vol.	Purge volume - The purge volume only appears, if integration purging method is chosen.
Min.Fl. P.	Minimum flow rate during purging process
Min.Fl .O.	Minimum flow rate during operating
Rated Fl.	Flow rate set-point - In operation mode 'continuous flow' this flow rate will be regulated, while normal operation.
Min.Pres.	Minimum pressure inside enclosure Only values above ≥ 0.8 mbar can be entered. (Additional safety regulation to EN 50016)
Max.Pres.	Maximum pressure inside enclosure Maximum pressure ≤ 18 mbar
R. Pre. Pu.	Pressure set-point during purging , This pressure value will be regulated during purging process.
Rated Pr.	Pressure set-point during normal operation , This pressure value will be regulated during normal operation.
- Option! -	Sig. Pres	Signal pressure during normal operation , If the housing pressure is below the signal pressure the Terminals 21/22 are open!
Codes	M-Code	Menu code - Code word to enter main menu out of operation mode. The M-code could not be switched off by setting M-Code = „0000“. Bypass code - Code word to activate the bypass. The bypass code word can be switched off by setting „0000“. The bypass code „9999“ blocks the bypass function. In that case a bypass can only be activated by key-operated switch on BT 81x.
	By-Code	
	On/Off-C.	On/Off code , enables switching on or off the ignition-capable device. The On/Off code word can be switched off with „0000“.

4.4.3 Configuration Example

Example- Ex p-System

- ⇒ Enclosure volume: 500 l
- ⇒ Language : English
- ⇒ Structure :
 - Operation mode: leakage compensation
 - Integration purging method
 - Proportional solenoid valve
- ⇒ Parameters
 - Purgung volume: 2500 l
 - Minimum pressure of enclosure: 0.8 mbar
 - Maximum pressure of enclosure: 12 mbar
 - Set-point pressure purging process: 10 mbar
 - Set-point pressure normal operation: 1.5 mbar
- ⇒ Codes
 - M- Code: 0100
 - By-Code: 1200
 - E/A-Code: 0003

Procedure:

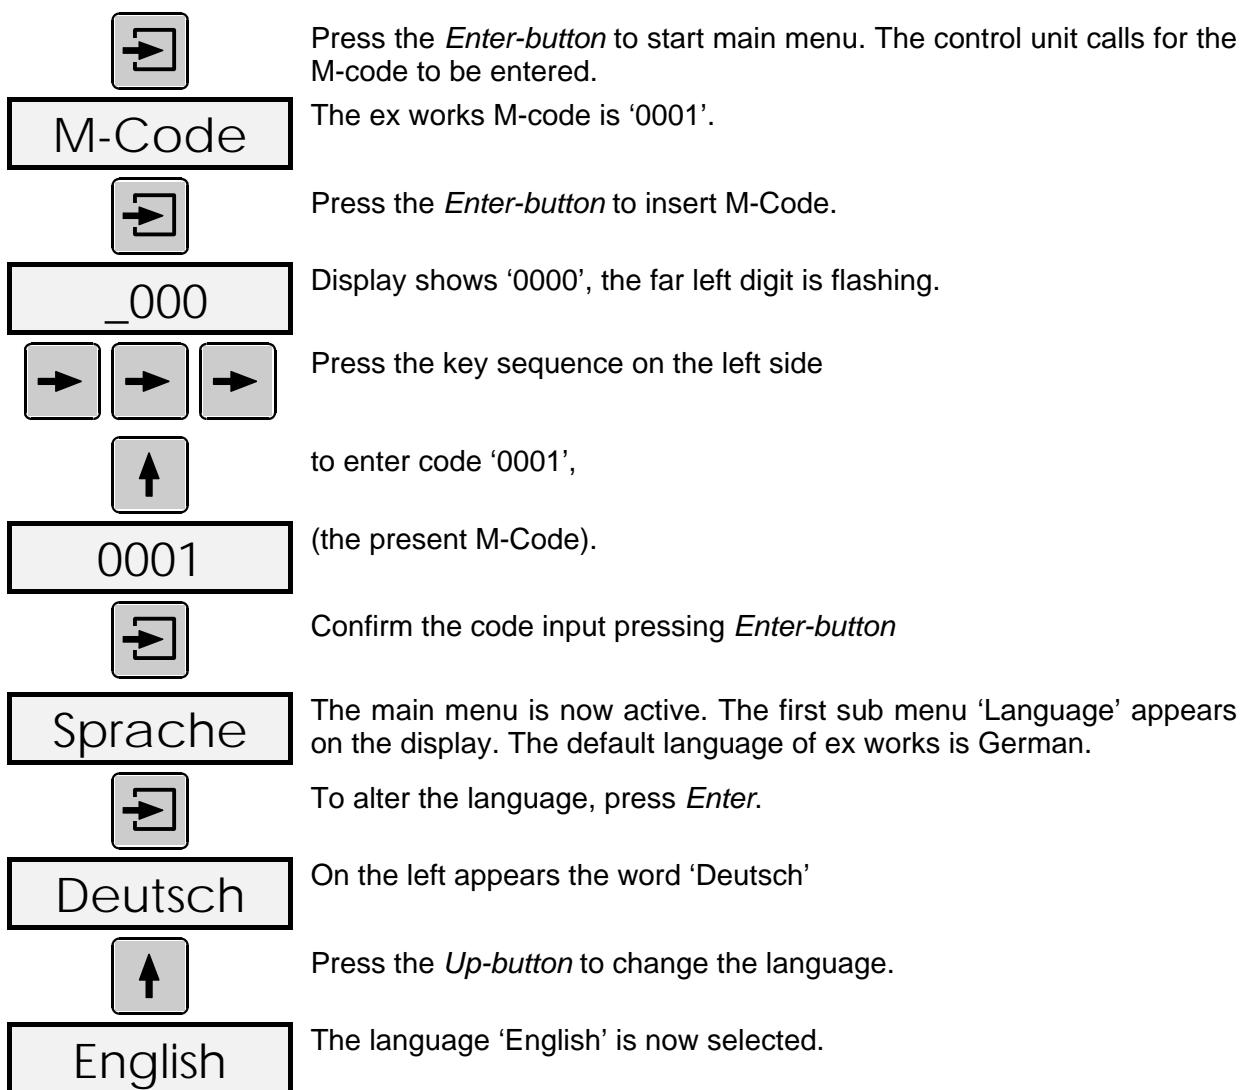

-  Press the *Enter-key* to confirm the change.
- Structure**  Category 'Structure' appears.
- Valves**  Press the *Enter-key* to configure the Ex p-system structure.
- D-Valve**  The first item of the structure menu is the choice of the solenoid valve.
Press the *Enter-key* to change state.
- P-Valve**  The present state is digital solenoid valve.
Change the state by pressing *Up-key* -
The new state is now 'Proportional solenoid valve'.
- Cont.Flow**  Confirm the change by pressing *Enter-key*.
This item is the operational mode 'continuos flow' or 'leakage compensation'. The ex works state is already 'leakage compensation' therefore:
skip this item by pressing the *Up-key*.
- Param.**  The structure menu is now finished. The main menu continues automatically with the pre-selected parameters.
- Pur. Vol.**  Start the parameter category by pressing the *Enter-key*.
The first menu item 'Purging volume' appears.
- _00500 l**  Press the *Enter-key* to enter the desired volume '2500 l'.
Expecting a pre-set purging volume of 500 l, the input sequence is as follows:
- 
00_500 l

002500 l
-  Confirm the input by pressing the *Enter-key*.
- Min Fl. P.**  The minimum flow while purging can be increased for special applications. In this case leave the default

Min.Pres	The desired minimum pressure of 0.8 mbar is already adjusted ex works. Continue skipping this menu item by pressing the <i>Up-</i> key or view by pressing the <i>Enter-</i> key.
Max.Pres.	Now enter the desired value of the maximum pressure. Modify the present parameter as shown above.
012.0mbar	The desired maximum pressure is 12.0 mbar.
R. Pre. Pu	The desired set-point pressure during the purging process of 10.0 mbar is already adjusted ex works. Continue passing this menu item by pressing the <i>up-</i> key.
Rated Pre.	The desired set-point pressure during normal operation must be adjusted. Modify the present parameter to 1.5 mbar as shown above.
Codes	The parameter category is now finished. The main menu continuous automatically with the sub menu codes.
M-Code	Modify M-Code to '0100' as shown above. Please note: the M-Code cannot be set to '0000' .
By-Code	Modify By-Code to '1200' as shown above.
On/Off-C.	Set the On/Off-Code to switch the ignition-capable apparatus on or off to '0003'.
End	The main menu settings are now complete.
	After pressing the <i>Enter-</i> key, the purging system is in operation state.

4.5 Alarm and malfunction indications

Alarm	Cause	Actions
Ext.Alar	The external alarm occurred, i.e. the external alarm loop is broken. If the external alarm loop is not used, disable the external alarm loop by a shorting bridge.	Fix shorting bridge to terminal 4 and 10 of the control unit FS 850S.

Error message	Cause	Remedy
Error E.	EEPROM Read Error Stored configuration data is incomplete or corrupt.	
Error P.	Pressure sensor Error - The integrated pressure sensors do not work properly	Turn FS 850S off. Turn FS 850S on. If the error message occurs again,
Error F.	flow sensor Error - The integrated flow sensors do not work properly	then return the control unit FS 850S to Gönnheimer Elektronik.
Error C.	Hardware - fault	

5 Flow charts

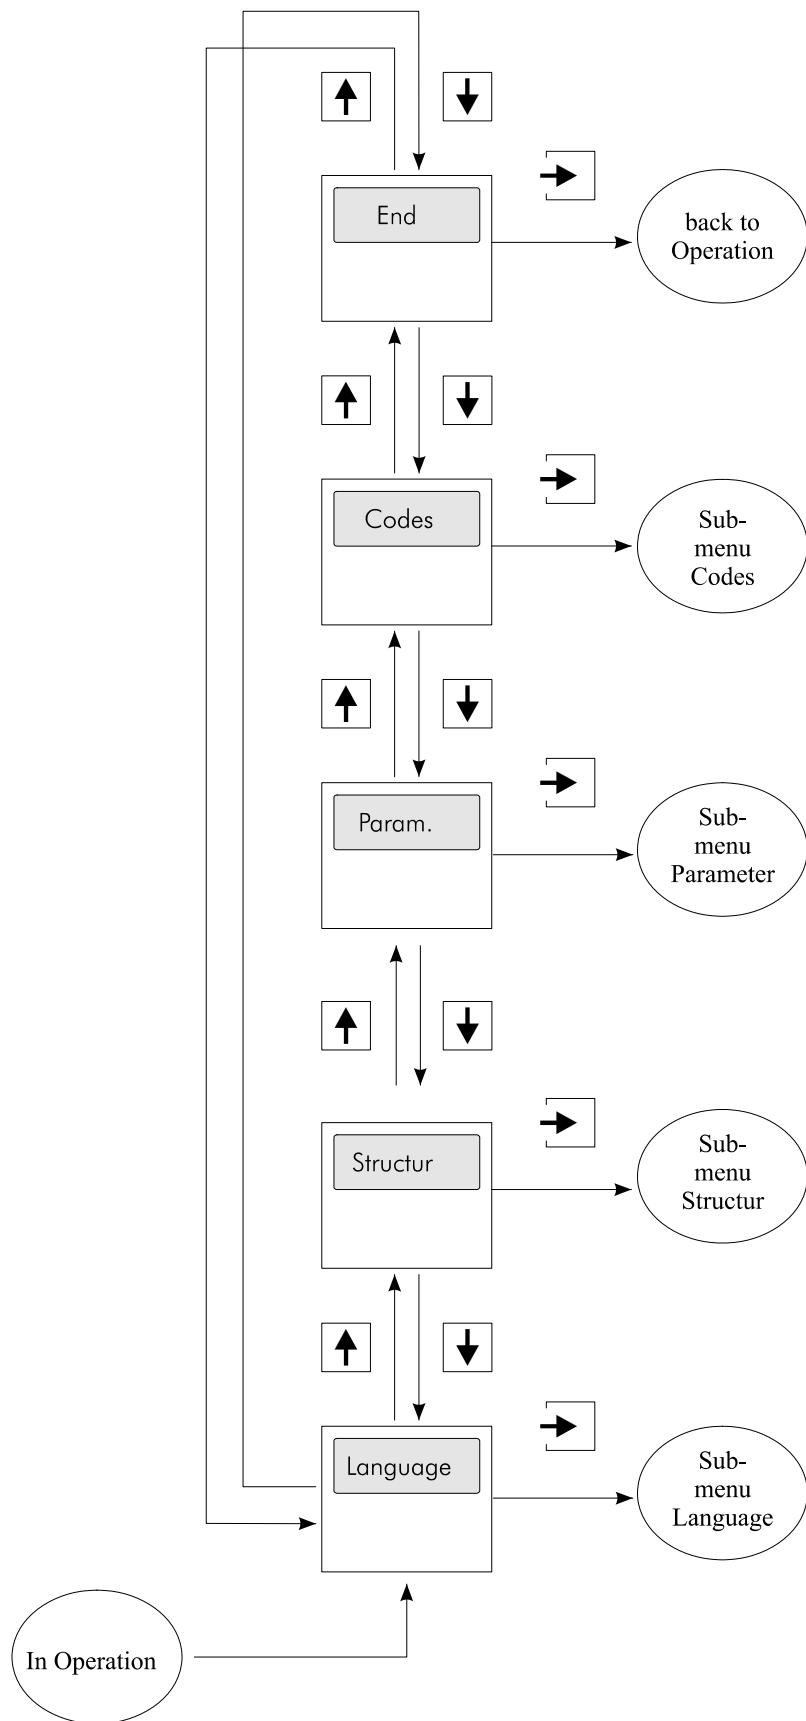


Figure 4 Flow chart main menu

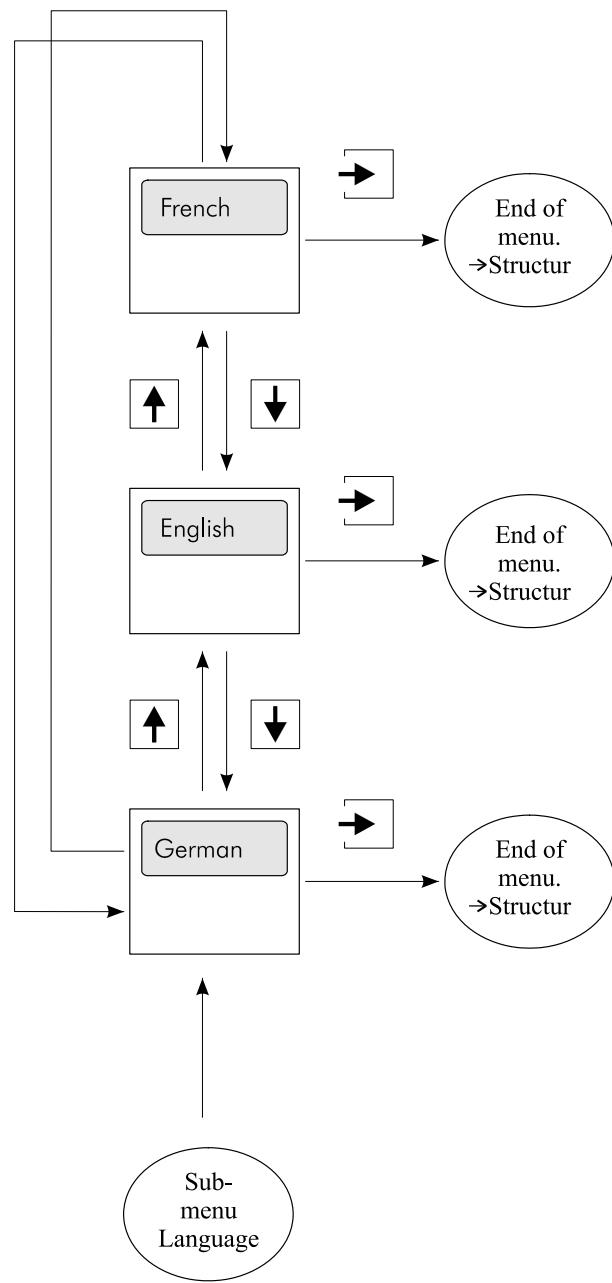
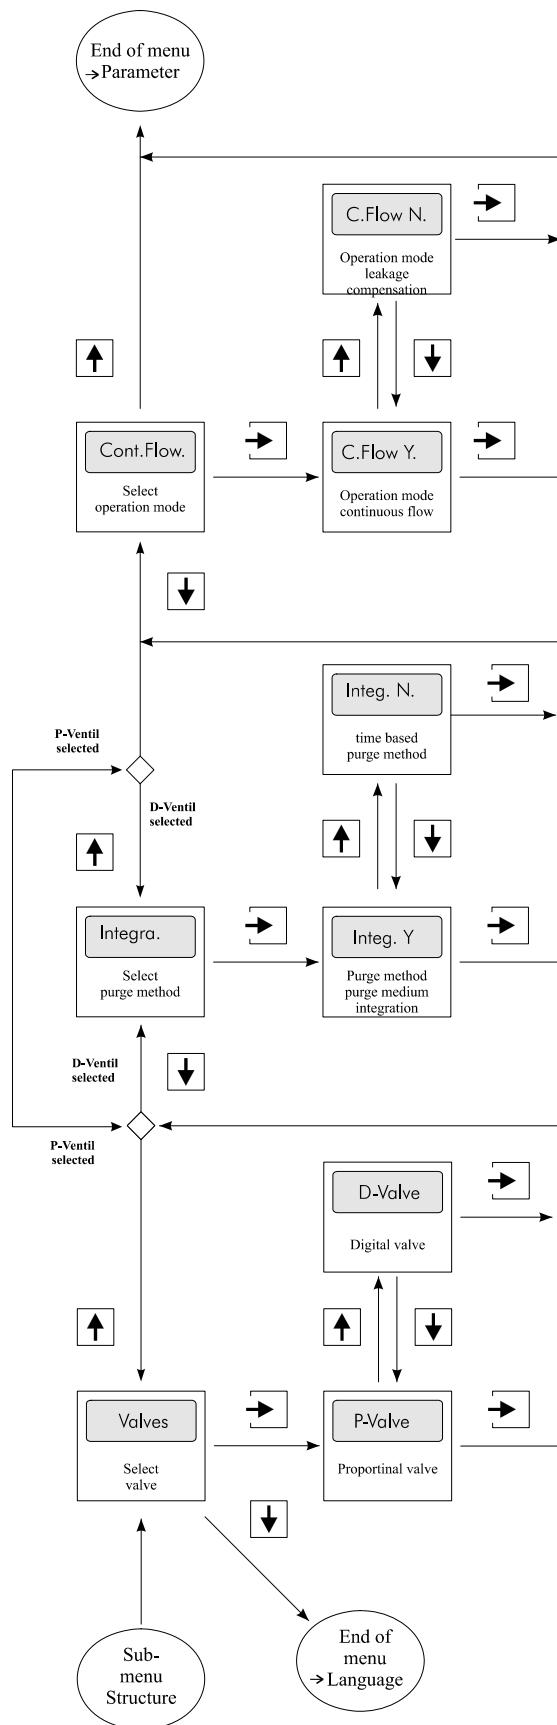
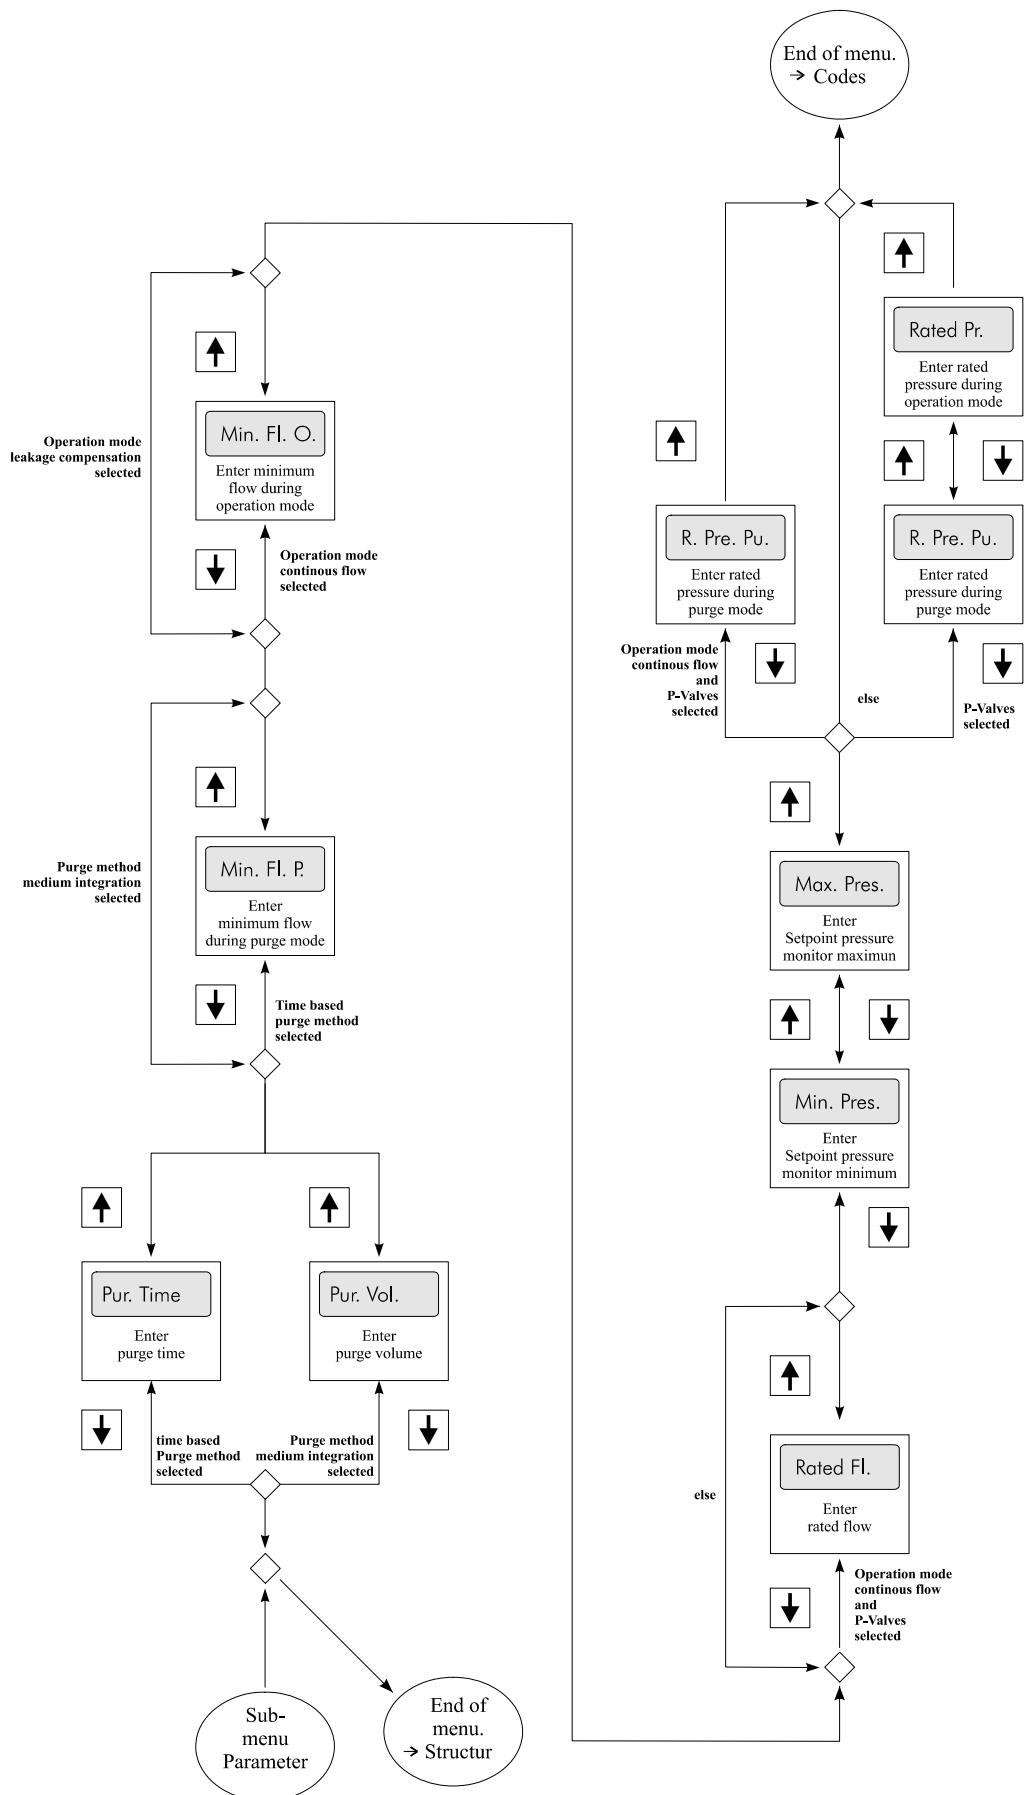


Figure 5 Flow chart language menu

**Figure 6 Flow chart structure category**

**Figure 7 Flow chart parameter category**

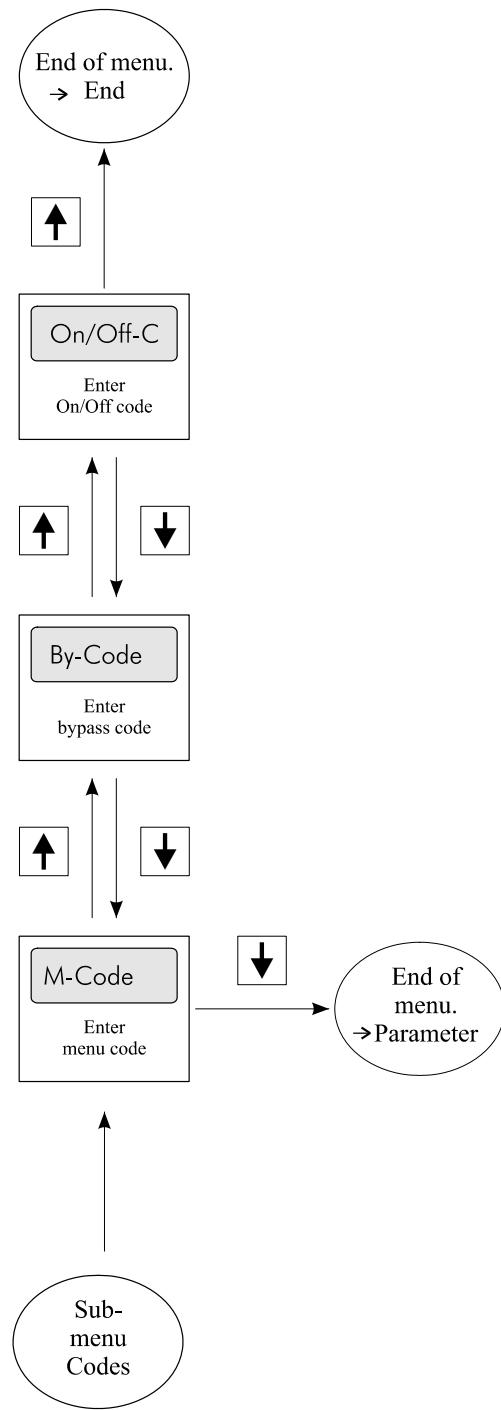


Figure 8 Flow chart code category

6 Appendix

6.1 Tables

plate orifice size

Plate orifice [mm]	Flow rate is about [m ³ /h]
4	0,5 ... 1,1
6	1,1 ... 2,7
10	2,5 ... 6,5
14	6 ... 11
18	9 ... 15

The right diameter of the plate orifice depends upon the desired volume flow rate on the enclosure outlet and the built in nozzle of the solenoid valve. Flow rates into enclosure depend upon primary pressure and nozzle diameter.

Pres- sure [bar] [10 ⁵ P a]	Flow rate [l/s] $\rho_{\text{Air}} = 1,293 \text{ kg/m}^3$									
	Nozzle diameter [mm]									
0,3	0,5	0,7	1	1,5	2	3	4	5	6	
1,5	0,0275	0,076	0,149	0,304	0,693	1,208	2,676	4,653	7,06	9,796
2	0,0338	0,094	0,184	0,374	0,838	1,48	3,27	5,651	8,511	11,098
2,5	0,0391	0,109	0,213	0,433	0,968	1,708	3,759	6,471	9,685	13,199
3	0,0438	0,0121	0,238	0,484	1,063	1,908	4,186	7,177	10,682	14,445
3,5	0,048	0,133	0,261	0,53	1,195	2,087	4,569	7,804	11,554	15,511
4	0,0518	0,144	0,282	0,573	1,28	2,252	4,917	8,37	12,33	16,441
4,5	0,0554	0,154	0,301	0,612	1,367	2,404	5,239	8,883	13,032	17,263

6.2 Type code

Control unit FS850S		.	.	.
Mains voltage:	230 VAC0		
	120 VAC2		
	24 VDC6		
Plate orifice:	4 mm, range 0,5 ...1,1 m ³ /h0		
	6 mm, range 1,1 ...2,7 m ³ /h2		
	10 mm, range 2,5 ...6,5 m ³ /h4		
	14 mm, range 6 ...11 m ³ /h6		
	18 mm, range 9 ...15 m ³ /h8		
Alarm contact:				
	Absent (2 nd digital valve on te. 21,22)0		
	Present1		

More voltages on demand;

Accessories: Additive window in control unit (recommendable, if no operation panel is used)

Operation panels	BT
Intelligent operation panel, Ex ib IIC T6, for mounting on the front	BT851.0
Intelligent operation panel, Ex ib IIC T6, with IP65 housing	BT851.5
Operation panel, Ex ib IIC T6, for mounting on the front with key-operated switch	BT854.0 BT854.1
Operation panel, Ex ib IIC T6, with IP65 housing with key-operated switch	BT855.0 BT855.1

Solenoid valve		SV
Working type:								
digital			D					
proportional			P					
Effective channel diameter:								
2 mm.....			.2					
3 (SVP: up to 300 ltr. Cabinet size).....			.3					
5 (SVP: bigger than 300 ltr. Cabinet size).....			.5					
n mm (at SVD; diameter of the built in nozzle)n					
Standard area								
Europe (ATEX)			-A					
USA (NEC 500)			-U					
Power supply								
230V			0					
110 – 120V			2					
24 V			6					
Work out								
Standard with 3m cable, brass body			0					
With Ex e terminal box, brass body			K					

Fuse for solenoid valve			Nominal	Order.Nr
(Ex-version)				
U_{Nominal}	SVP	SVD	100 mA	SI850.0
230 VAC, 220 VAC	200mA	100mA	160mA	SI850.1
120 VAC, 110 VAC	315mA	160mA	200 mA	SI850.2
24 VAC, 24 VDC	1,6 A	630mA	315 mA	SI850.3
			500 mA	SI850.4
			630 mA	SI850.5
			1000 mA	SI850.6
			1600 mA	SI850.7
			2000mA	SI850.8

Remark: please order the Ex- solenoid valve fuse separately

6.3 Technical Details

Control unit FS850S		
General	Mounting	inside hazardous area
	Ex- protection class	See paragraph 6.4 Marking
	EC- type exam.cert.	DMT 99 ATEX E 003 BVS 06 ATEX E 088
	Environment protection	IP 65 (Remark: without outlet drill)
Housing	Dimensions	H x W x D: 220 mm x 120 mm x 90 mm
	Material	Aluminium, lacquered / Ral 7035
Electrical specifications	Power consumption	About 2.5 VA (without peripherals)
	Main voltage	24VDC, 24VAC, 110VAC, 120VAC, 220VAC, 230VAC 48 ... 62 Hz
	Working circuits Terminal 11, 12, 13, 14	AC: U ≤ 250VAC, I ≤ 5A at cos φ > 0,7 DC: U ≤ 30 VDC, I ≤ 5 A, P ≤ 150 W
	Control circuits Terminal 1..10	Ex protection class: intrinsically safe Ex ib IIC see declaration of conformity for further details
	Min. and max. clamping torque	min. 0,3 Nm max. 0,4 Nm
	Min. und Max. wire cross- section	steep: 0,2 – 2,5 mm ² flexible: 0,2 – 2,5 mm ²
Pneumatic	Pressure range	0 - 22 mbars
	Flow rate range	0,5.. 15 m ³ /h, dependent upon plate orifice size
Mounting	Position	Position independent, only intake and outlet of the control unit should be lined up on a horizontal axis.
	Environment temperature	-10°C ... +50°C at T6 -10°C ... +60°C at T4
	Humidity	5-95%, non-condensing
Ex p Configuration	Parameter input	LC-Display, menu guided Different languages : German, English, French, Dutch, Spanish
	Storage	by EEPROM double saved with CRC
Safety standard	SIL parameters	HFT = 1 device category 3 PFH = 170 FIT SIL 2 service interval: 3 years

6.4 Marking

Marking of type FS850S:

	II 2 G Ex eb mb [ib] [pxb] IIC T6 oder Ex e mb [ib] [px] IIC T6 Gb II 2 G Ex eb mb [ib] [pxb] IIC T4 oder Ex e mb [ib] [px] IIC T4 Gb II 2 D Ex tb [ib] [p] IIIC T70 C IP65 oder Ex tb [ib] [p] IIIC T70 C Db IP65	-20°C ≤ T _A ≤ +45°C -20°C ≤ T _A ≤ +60°C -20°C ≤ T _A ≤ +60°C
---	--	--

Marking of type FS850S.*.*.*.HT:

	II 2 G Ex eb mb [ib] [pxb] IIC T4 oder Ex e mb [ib] [px] IIC T4 Gb	-20°C ≤ T _A ≤ +70°C
---	--	--------------------------------

Marking of operator panel BT851:

	II 2 G Ex ib IIC T6 oder Ex ib IIC T6 Gb II 2 D Ex ib IIIC T 80 C Db oder II 2 D Ex ib IIIC T 80 C	
---	---	--

6.5 Block diagrams

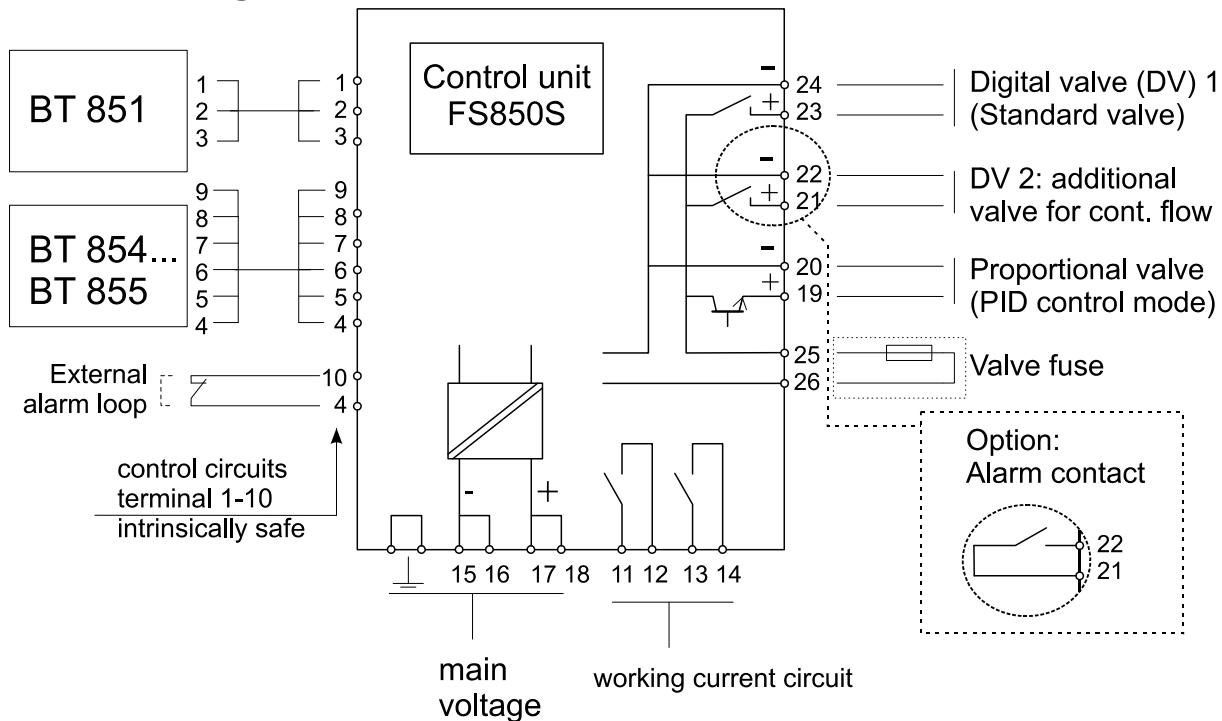


Figure 9 Electrical block diagram

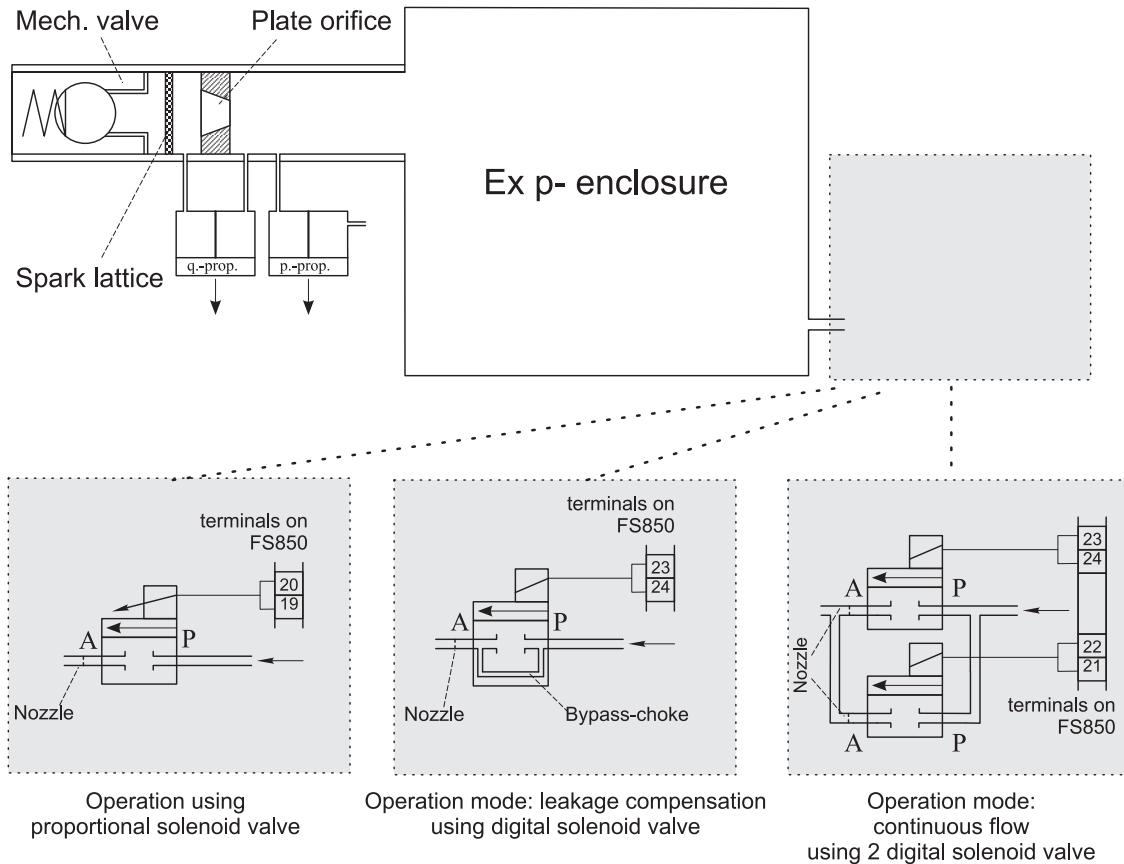


Figure 10 Pneumatic block diagram

6.6 Dimensions

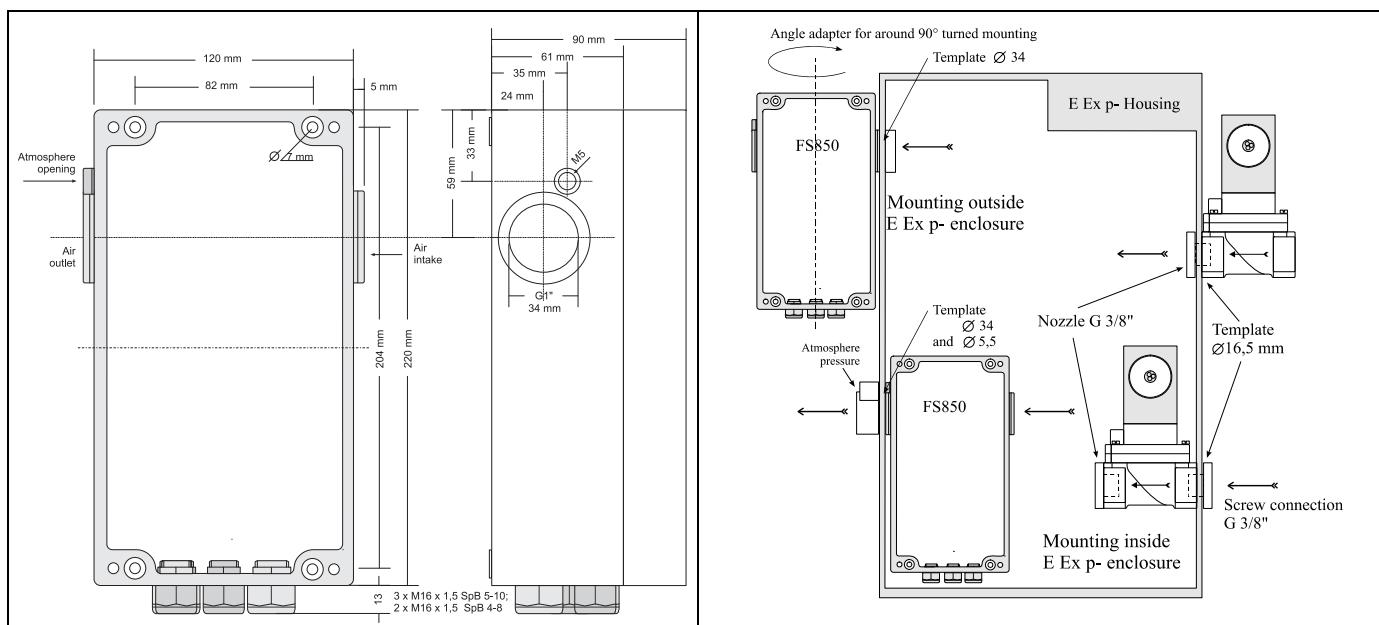


Figure 11: Dimensions FS 850S

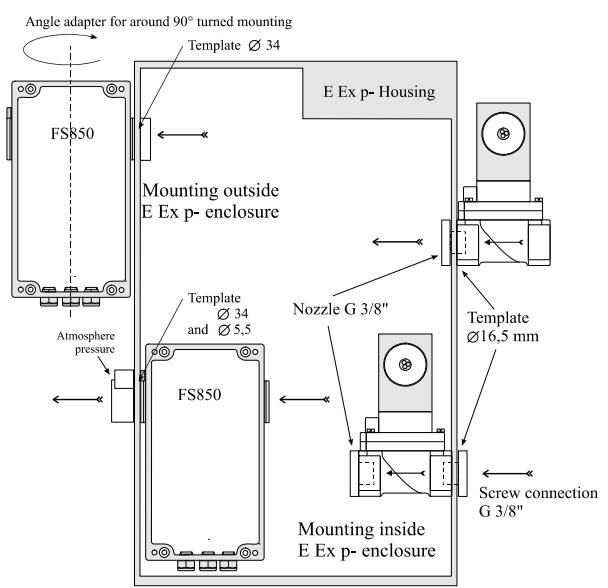


Figure 12: Mounting examples

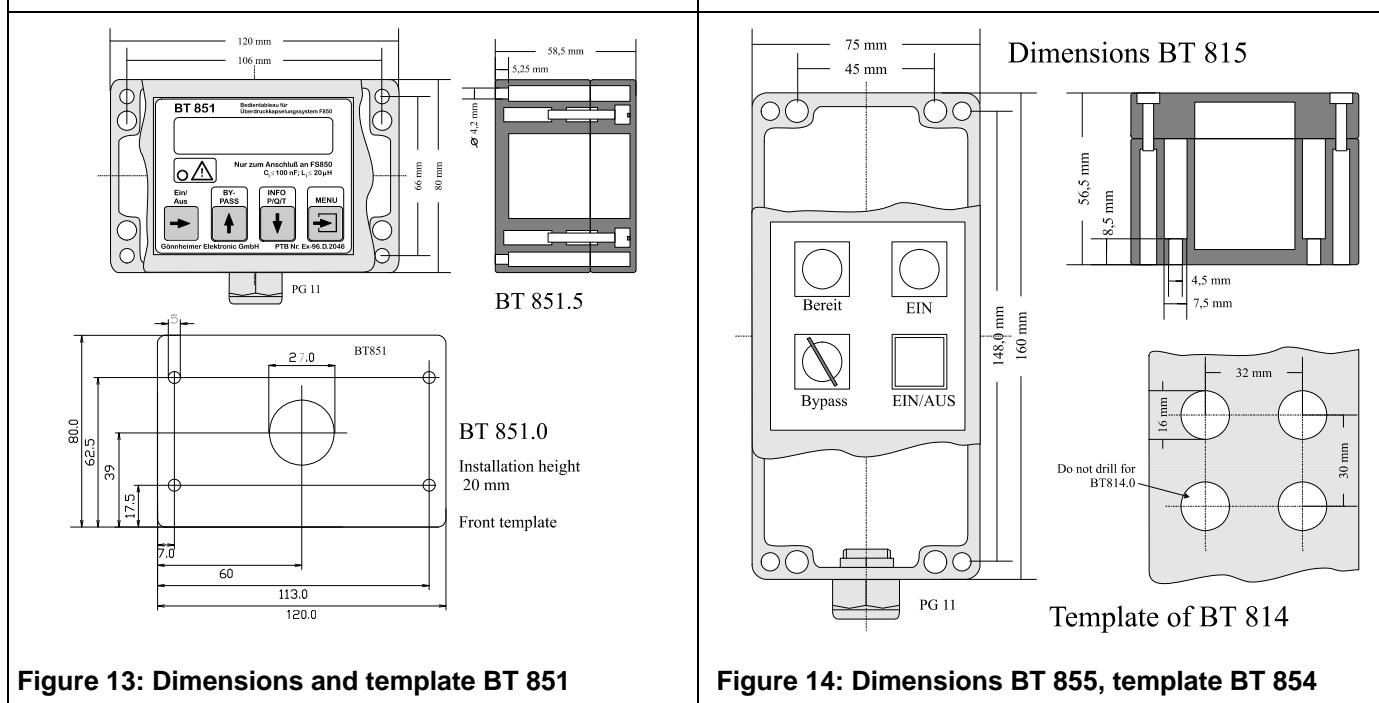


Figure 13: Dimensions and template BT 851

Figure 14: Dimensions BT 855, template BT 854

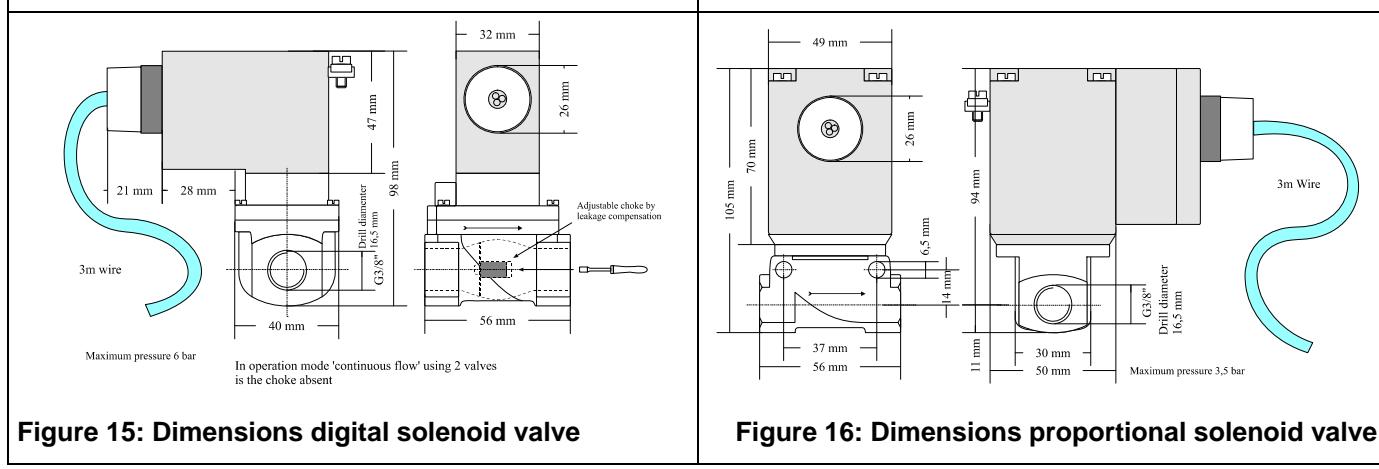


Figure 15: Dimensions digital solenoid valve

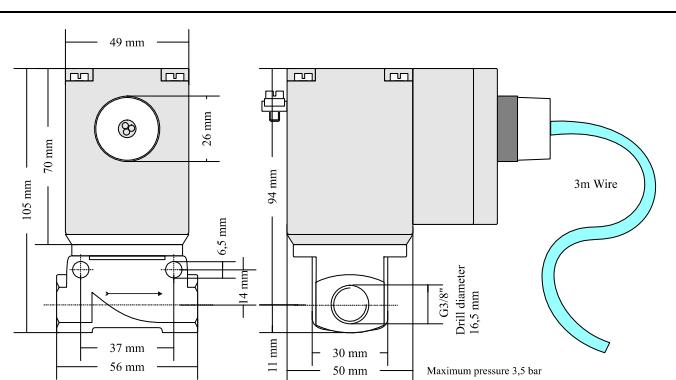


Figure 16: Dimensions proportional solenoid valve

6.7 Sequence of operation diagram

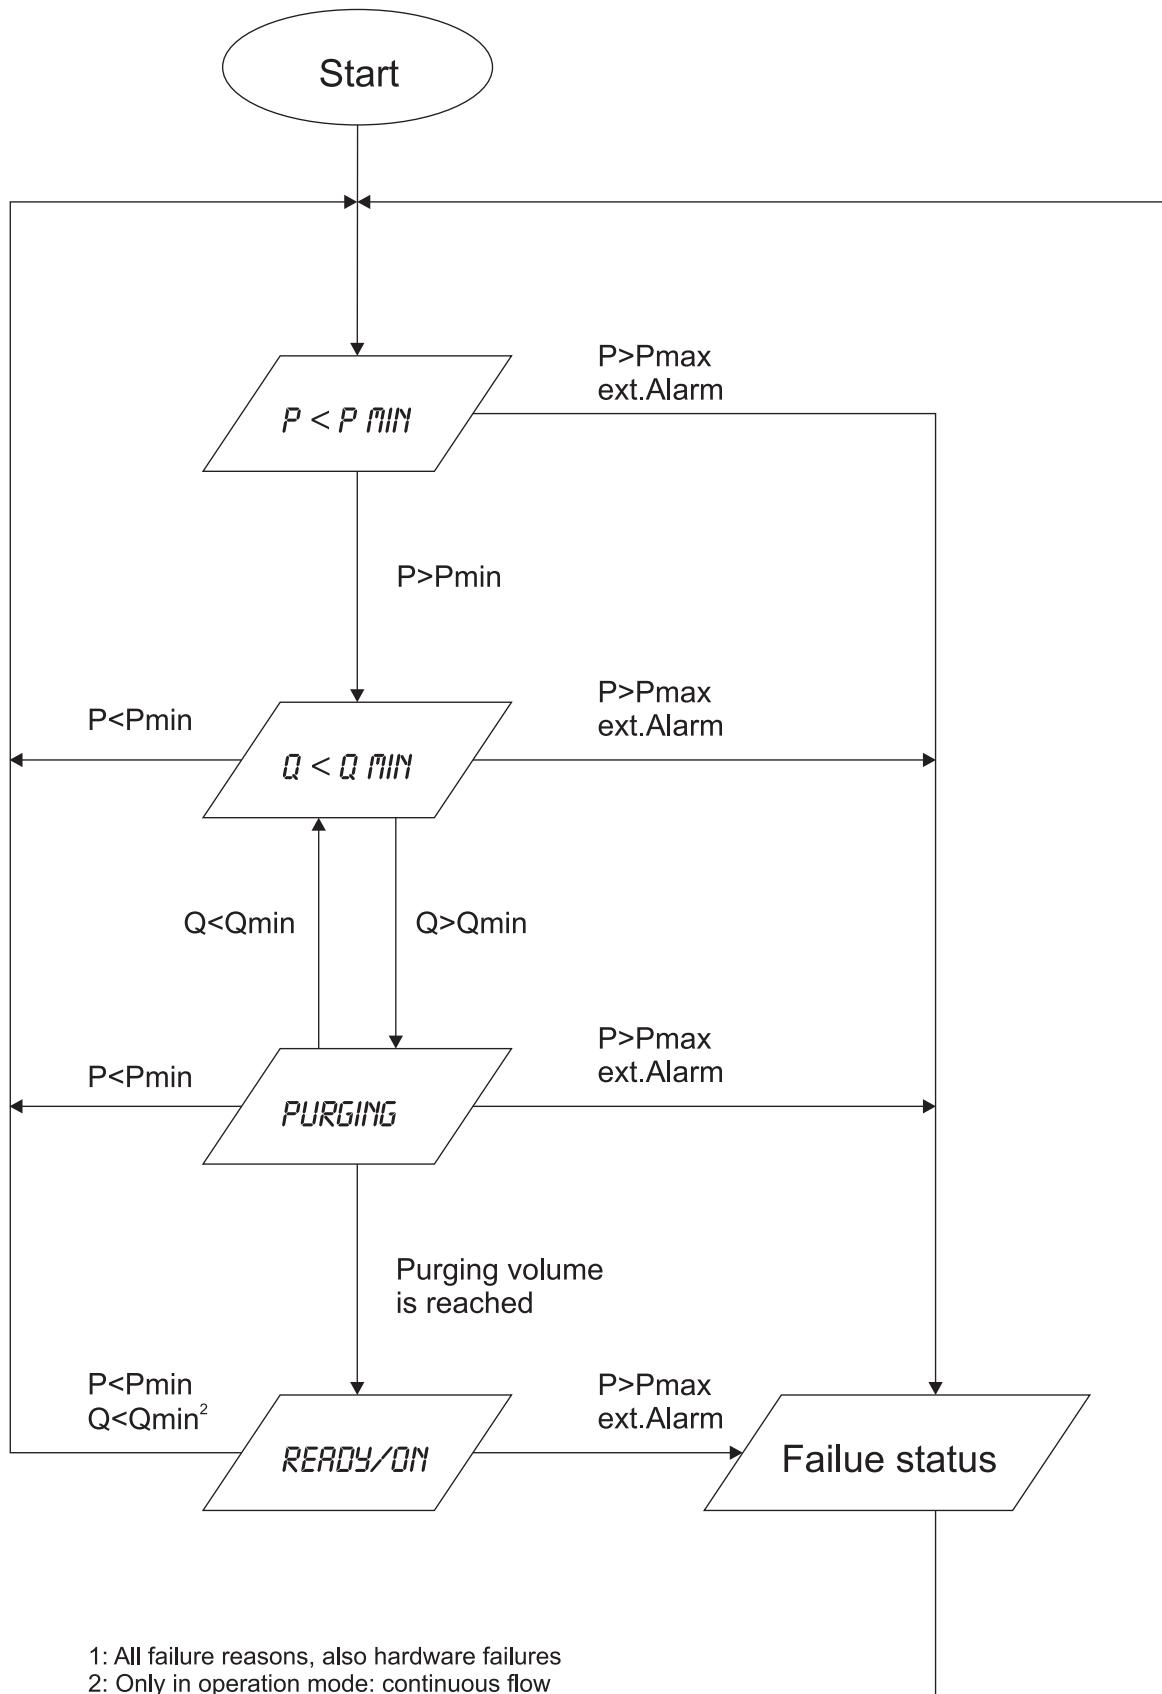


Abbildung 17: Flow chart operation diagram

6.8 List of Parameters

System identifica- tion	Installation no.:	Date:	
FS 850S. .	Production no.:	Solenoid valve	BT 8

Inputs	Description	Display	Value/ state	
Language	F850S language	Language		
Structure				
Valve	Solenoid valve type used with this purging system?	Valves Tick box	P-Valve <input type="checkbox"/>	D-Valve <input type="checkbox"/>
Purging method	Time based purging method (Integ. N.) or integration purging method (Integ. Y.)	Integra. Tick box	Integ. Y. <input type="checkbox"/>	Integ. N. <input type="checkbox"/>
Operational mode	Continuous flow (C. flow Y.) or leakage compensation (C. flow N.)	Cont. Flow Tick box	C. Flow Y. <input type="checkbox"/>	C. Flow N. <input type="checkbox"/>
Parameters	Purge time	Pur. Time		
	Purge volume	Pur. Vol.		
	Minimum flow rate during purging procedure	Min. Fl. P.		
	Minimum flow rate during normal operation by op. mode continuous flow	Min. Fl. O.		
	Set-point flow rate by operation mode continuous flow	Rated Fl.		
	Pressure monitor, minimum pressure	Min. Pres.		
	Pressure monitor, maximum pressure	Max. Pres		
	Set-point pressure during purging	R. Pre. Pu.		
	Set-point pressure during normal operation	Rated Pr.		
Codes	Code for main menu	M-Code		
	Code for bypass	By-Code		
	Code to enable switching ignition-capable device	On/Off-C.		

7 Additions/changes of the manual for F850S

7.1 Ergänzungen / Änderungen zu Softwareversion 9.7.4

Connections:

Alarm contact: term. 21,22

Seite 9

Basic settings:

Purge volume	1000 l
Min. flow	3,0 l/s
Min. pressure	1,5 mbar
Max. pressure	27 mbar
Set point pressure while purging phase	18 mbar
Set point pressure while normal op.	3,0 mbar
Alarm pressure	2,0 mbar

Seite 10

Technische Details:

Pressure measurement	0,0 – 30mbar
Adjustable min. pressure:	0,8 mbar
Adjustable max. pressure:	27 mbar

Seite 23

7.2 Additions/changes of the manual for F850S, option: Decrease of pressure signal alarm

Device types: FS850S.x.x.1; Software version 2.0.7 and higher

Connection:

Alarm relay, clamps 22,21

Page 7

Function:

With this option a spontaneous decrease of pressure is announced over a passive relay contact. In the parameter menu of the FS850S the reporting pressure is specified. If the housing internal pressure falls during the enterprise below this reporting pressure, then the early warning opens relay contact. This signal can be evaluated problem-free in the control room. The relay contact is implemented in Ex e clamps, therefore the inquiry signal cannot be intrinsically safe implemented into the control room.

Function table:

Status, operating condition	Relay contact
P > reporting pressure, broad or	Relay contact closed
Otherwise	Relay contact open

7.3 Additions/changes of the manual for F850S, option: bypass monitor

Device types: FS850S.x.x.1; Software version 3.1.3 or higher

Connection:

Alarm relay, clamps 22,21

Page 7

Function:

If the user activates the pressure bypass function the Contact 21-22 is open, otherwise it's closed.

Function table:

Status, operating condition	Relay contact
Bypass mode is active	Relay contact open
Otherwise	Relay contact closed



Translation

EC-Type Examination Certificate

(1)

- Directive 94/9/EC -
Equipment and protective systems intended for use
in potentially explosive atmospheres

(3)

BVS 06 ATEX E 088

(4)

Equipment: Pressurised enclosure systems types F 850 S and F 860 S

(5)

Manufacturer: Gönnheimer Elektronik GmbH

(6)

Address: 67433 Neustadt/Weinstraße, Germany

(7)

The design and construction of this equipment and any acceptable variation thereto are specified in the appendix to this type examination certificate.

(8)

The certification body of EXAM BBG Prüf- und Zertifizier GmbH, notified body no. 0158 in accordance with Article 9 of the Directive 94/9/EC of the European Parliament and the Council of 23 March 1994, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres, given in Annex II to the Directive.

The examination and test results are recorded in the test and assessment report BVS PP 06.2078 EG.

(9)

The Essential Health and Safety Requirements are assured by compliance with:

EN 60079-0:2004	General requirements	EN 60079-2:2004	Pressurised Enclosure 'p'
EN 60079-7:2003	Increased Safety 'e'	FDIS IEC 60079-11:2005	Intrinsic Safety 'i'
EN 60079-18:2004	Encapsulation 'm'	IEC 61241-0:2004	General requirements
EN 61241-1:2004	Protection by Enclosures 'tD'	IEC 61241-11:2005	Intrinsically safe equipment
EN 954-1:1996	Safety devices required for the safe functioning of equipment with respect to explosion risks		

(10)

If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the appendix to this certificate.

(11)

This EC-Type Examination Certificate relates only to the design, examination and tests of the specified equipment in accordance to Directive 94/9/EC.

Further requirements of the Directive apply to the manufacturing process and supply of this equipment. These are not covered by this certificate

(12)

The marking of the equipment shall include the following:



II 2G for FS850S, FS860S and BT 851
II 2D for FS850S and BT 851

details see 15.1**EXAM BBG Prüf- und Zertifizier GmbH**Bochum, dated 25th July 2006

signed: Migenda

signed: Dr. Arnold

Certification body

Special services unit

(13)

Appendix to

(14)

EC-Type Examination Certificate

BVS 06 ATEX E 088

(15) 15.1 Subject and type

Pressurised enclosure systems of types F 850 S and F 860 S

Control unit type FS850S:

<input checked="" type="checkbox"/> II 2G Ex e mb [ib] [px] IIC T6	-20 °C ≤ T _A ≤ +45 °C
<input checked="" type="checkbox"/> II 2G Ex e mb [ib] [px] IIC T4	-20 °C ≤ T _A ≤ +60 °C
<input checked="" type="checkbox"/> II 2D Ex tD [ibD] [pD] A21 IP 65 T 70 °C	-20 °C ≤ T _A ≤ +60 °C

Control unit type FS850S.***.HT:

<input checked="" type="checkbox"/> II 2G Ex e mb [ib] [px] IIC T4	-20 °C ≤ T _A ≤ +70 °C
--	----------------------------------

Control unit type FS860S:

<input checked="" type="checkbox"/> II 2G Ex e mb [ib] [px] IIC T6	-20 °C ≤ T _A ≤ +45 °C
<input checked="" type="checkbox"/> II 2G Ex e mb [ib] [px] IIC T4	-20 °C ≤ T _A ≤ +60 °C

Operator panel BT 851:

<input checked="" type="checkbox"/> II 2G Ex ib IIC T6	
<input checked="" type="checkbox"/> II 2D Ex ibD 21 T 80 °C	

15.2 Description

The pressurised enclosure systems of types F 850 S and F 860 S are used to assemble explosion proof electrical equipment for the type of protection Pressurised Enclosure (Pressurisation) according to EN/IEC 60079-2 and EN/IEC 61241-4. They consist of the control units FS 850 S or FS 860 S and the operator panel BT 851 plus additional accessory equipment.

The functional safety of the pressurised enclosure system type F 850 S was tested according to the standard "Safety devices required for the safe functioning of equipment with respect to explosion risks". It complies with category 3 of this standard.

15.3 Parameters

Power supply (mains) (Terminals 15 to 18)	230, 220, 120, 110, 24 V AC, or. 24 V DC Safety-relevant maximum value U _m = 253 V									
Valve fuse (Terminals 25/26)	accessory valve fuse of type SI850									
Valve connections (Terminals 21/22 and 23/24)	Same voltage as power supply (mains)									
Proportional valve connection (Terminals 19/20)	Same voltage as power supply (mains)									
Contact circuits (Terminals 11/12 and 13/14)	<table border="0"> <tr> <td style="text-align: right;">ACV</td> <td style="text-align: center;">U = 250 V</td> <td style="text-align: left;">DCV</td> </tr> <tr> <td style="text-align: right;">I = 5 A</td> <td style="text-align: center;">I = 5 A</td> <td></td> </tr> <tr> <td style="text-align: right;">cosφ = 0.7</td> <td></td> <td style="text-align: left;">P = 150 W</td> </tr> </table>	ACV	U = 250 V	DCV	I = 5 A	I = 5 A		cosφ = 0.7		P = 150 W
ACV	U = 250 V	DCV								
I = 5 A	I = 5 A									
cosφ = 0.7		P = 150 W								



Intrinsically safe connections

in type of protection Intrinsic Safety Ex ib IIC

The maximum values, the maximum permitted values and the outer reactances as well as the numbers of the terminals are shown in the table below:

Terminal	U_0	I_0	P_0	L_0	C_0
1, 9	8.61 V	51 mA	110 mW	10 mH	2 μ F
4	8.61 V	10 mA	22 mW	10 mH	2 μ F
3	8.61 V	20 mA	44 mW	10 mH	2 μ F
5, 6, 10	8.61 V	6 mA	13 mW		
2	Mass connection of circuits				

The intrinsically safe circuits (terminals 1 to 10) are safely galvanically separated from all other circuits up to the peak value of the nominal voltage of 375 V.

The permitted ambient temperature range is for temperature class T6 -20 °C to 45 °C and for temperature class T4: -20 °C to 60 °C.

For control unit type FS850S.*.*.HT (only T4) the permitted ambient temperature range is -20 °C to 70 °C.

(16) Test and assessment report

BVS PP 06.2078 EG, Stand 25.07.2006


(17) Special conditions for safe use

None

We confirm the correctness of the translation from the German original.
In the case of arbitration only the German wording shall be valid and binding.

DEKRA EXAM GmbH
44809 Bochum, 09.07.2012
BVS-Schu/Ar E 1215/12

Certification body


Special services unit



Translation

1st Supplement

(Supplement in accordance with Directive 94/9/EC Annex III number 6)

to the EC-Type Examination Certificate BVS 06 ATEX E 088

Equipment: Pressurised enclosure systems types F 850 S and F 860 S

Manufacturer: Gönnheimer Elektronic GmbH

Address: 67433 Neustadt/Weinstraße, Germany

Description

The control units of the pressurised enclosure systems may now also be manufactured according to testing documents listed in the pertinent test and assessment report.

The Essential Health and Safety Requirements of the modified equipment are assured by compliance with:

EN 60079-0:2004	General requirements	EN 60079-2:2004	Pressurised Enclosure 'p'
EN 60079-7:2003	Increased Safety 'e'	FDIS IEC 60079-11:2005	Intrinsic Safety 'i'
EN 60079-18:2004	Encapsulation 'm'	IEC 61241-0:2004	General requirements
EN 61241-1:2004	Protection by Enclosures 'tD'	IEC 61241-11:2005	Intrinsically safe equipment
EN 954-1:1996	Safety devices required for the safe functioning of equipment with respect to explosion risks		

The marking of the equipment shall include the following:

for type FS850S

- II 2G Ex e mb [ib] [px] IIC T6 or
- II 2G Ex e mb [ib] [px] IIC T4 and
- II 2D Ex tD [ibD] [pD] A21 IP 65 T 70 °C

for type FS850S.*.*.*.HT

- II 2G Ex e mb [ib] [px] IIC T4

for type FS860S

- II 2G Ex e mb [ib] [px] IIC T6 or
- II 2G Ex e mb [ib] [px] IIC T4

for type BT 851

- II 2G Ex ib IIC T6 and
- II 2D Ex ibD 21 T 80 °C



DEKRA

Test and assessment report
BVS PP 06.2078 EG, as of 23.10.2006

EXAM BBG Prüf- und Zertifizier GmbH

Bochum, dated 23rd October 2006

signed: Dr. Jockers

signed: Dr. Eickhoff

Certification body

Special services unit

We confirm the correctness of the translation from the German original.
In the case of arbitration only the German wording shall be valid and binding.

DEKRA EXAM GmbH
44809 Bochum, 09.07.2012
BVS-Schu/Ar E 1215/12

Certification body

Special services unit

To the newly added control units the following constant flow-through volume applies in relation to the monitored minimum overpressure:

Minimum overpressure	Constant flow-through volume	
	FS850S... .BY1,2	FS850S... .BY1,5
80 Pa	0.013 l/s	0.020 l/s
100 Pa	0.014 l/s	0.022 l/s
200 Pa	0.020 l/s	0.031 l/s
400 Pa	0.028 l/s	0.044 l/s
600 Pa	0.034 l/s	0.054 l/s
800 Pa	0.040 l/s	0.062 l/s
1000 Pa	0.044 l/s	0.070 l/s

Special conditions for safe use

None

Test and assessment report

BVS PP 06.2078 EG, as of 29.05.2007

DEKRA EXAM GmbH

Bochum, 29th May 2007

signed: Dr. Jockers

Certification body

signed: Dr. Eickhoff

Special services unit

We confirm the correctness of the translation from the German original.
In the case of arbitration only the German wording shall be valid and binding.

DEKRA EXAM GmbH
44809 Bochum, 09.07.2012
BVS-Schu/Ar E 1215/12

Certification body

Special services unit



Translation

2nd Supplement

(Supplement in accordance with Directive 94/9/EC, Annex III number 6)

to the EC-Type Examination Certificate BVS 06 ATEX E 088

Equipment: Pressurised enclosure systems types F 850 S and F 860 S
Manufacturer: Gönnheimer Elektronic GmbH
Address: 67433 Neustadt/Weinstraße, Germany

Description

The pressurised enclosure systems are supplemented by the following control units:

FS850S.*.*. BY1,2
FS850S.*.*. BY1,5
FS850S.*.*.HT.BY1,2
FS850S.*.*.HT. BY1,5.

These control units use an additional flow nozzle in the pressure monitoring module to achieve a continual purging which helps to control the minimum overpressure needed.

The Essential Health and Safety Requirements of the modified version are assured by compliance with:

EN 60079-0:2006	General requirements
EN 60079-2:2004	Pressurised Enclosure 'p'
EN 60079-7:2003	Increased Safety 'e'
EN 60079-11:2007	Intrinsic Safety 'i'
EN 60079-18:2004	Encapsulation 'm'
EN 954-1:1996	Safety devices required for the safe functioning of equipment with respect to explosion risks - general design principles
EN 61241-0:2006	General requirements
EN 61241-1:2004	Protection by Enclosure 'tD'
IEC 61241-11:2005	Intrinsically safe equipment 'iD'

The marking of the equipment remains unchanged.

Parameters

All electrical parameters remain unchanged.



Translation

(1) **3rd Supplement to the
EC-Type Examination Certificate**

- (2) Equipment and protective systems intended for use in potentially explosive atmospheres - Directive 94/9/EC
- (3) No. of EC-Type Examination Certificate: **BVS 06 ATEX E 088**
- (4) Equipment: **Pressurised Enclosed Systems Types 850S and 860S**
- (5) Manufacturer: **Gönnheimer Elektronic GmbH**
- (6) Address: **67433 Neustadt an der Weinstraße, Germany**
- (7) The design and construction of this equipment and any acceptable variation thereto are specified in the appendix to this type examination certificate.
- (8) The certification body of DEKRA EXAM GmbH, notified body no. 0158 in accordance with Article 9 of the Directive 94/9/EC of the European Parliament and the Council of 23 March 1994, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres, given in Annex II to the Directive. The examination and test results are recorded in the test and assessment report BVS PP 06.2078 EG.
- (9) The Essential Health and Safety Requirements are assured by compliance with:
- IEC 60079-0:2011 General requirements
EN 60079-2:2007 Pressurised Enclosure 'p'
EN 60079-7:2007 Increased Safety 'e'
EN 60079-11:2012 Intrinsic Safety 'i'
EN 60079-18:2009 Encapsulation 'm'
EN 60079-31:2009 Protection by Enclosure 't'
EN 50495:2010 Safety devices required for the safe functioning of equipment with respect to explosion risks
- (10) If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the appendix to this certificate.
- (11) This EC-Type Examination Certificate relates only to the design, examination and tests of the specified equipment in accordance to Directive 94/9/EC.
Further requirements of the Directive apply to the manufacturing process and supply of this equipment. These are not covered by this certificate.
- (12) The marking of the equipment shall include the following:



II 2G see section 15.1
II 2D see section 15.1

DEKRA EXAM GmbH
Bochum, dated 10th May 2012

Signed: Simanski

Signed: Hauke

Certification body

Special services unit

- (13) Appendix to
- (14) **3rd Supplement to the EC-Type Examination Certificate
BVS 06 ATEX E 088**
- (15) 15.1 Subject and type

Pressurised enclosure systems of the following types:

type F850S.*.*.* type F850S.*.*.*BY1,* type F860S.*.*.* type F860S.*.*.*BY1,*

The marking of the equipment has to include the following details:

Control unit type FS850S.*.*.* and type FS850S.*.*.*BY1,*:

alternatively

II 2G Ex e mb [ib] [px] IIC T6 Gb	Ex eb mb [ib] [pxb] IIC T6	-20°C ≤ T _a ≤ +45°C
II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20°C ≤ T _a ≤ +60°C
II 2D Ex tb [ib] [p] IIIC T 70 °C Db IP 65	Ex tb [ib] [pb] IIIC T 70 °C IP 65	-20°C ≤ T _a ≤ +60°C

Control unit type FS850S.*.*.*.HT und type FS850S.*.*.*.HT.BY1,*:

II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20°C ≤ T _a ≤ +70°C
-----------------------------------	----------------------------	--------------------------------

Control unit type FS860S.*.*.* und type FS860S.*.*.*BY1,*:

II 2G Ex e mb [ib] [px] IIC T6 Gb	Ex eb mb [ib] [pxb] IIC T6	-20°C ≤ T _a ≤ +45°C
II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20°C ≤ T _a ≤ +60°C

Operator panel BT 851:

II 2G Ex ib IIC T6 Gb	Ex ib IIC T6
II 2D Ex ib IIIC T 80 °C Db	Ex ib IIIC T 80 °C

15.2 Description

The circuits of the control units may now also be manufactured according to the test documents provided in the pertinent test and assessment report. Another reason for issuing this supplement was to evidence the compliance of the equipment with the updated standards listed above which in turn also requires a modification of the marking. The pressurised enclosure systems of types F 850 S and F 860 S were tested according to standard EN 50495: 2010, "Safety devices required for the safe functioning of equipment with respect to explosion risks". With regard to their functionality the systems are suitable for use in safety functions up to a safety integrity level of SIL 2. This assessment applies to the "high demand mode of operation". The software considered here is version 3.1.x as of 22.11.2005. The requirements of category 3 regarding one-fault safety are met; this corresponds with a hardware fault tolerance of HFT = 1.

15.3 Parameters

All parameters remain unchanged.

- (16) Test and assessment report

BVS PP 06.2078 EG as of 10th May 2012

- (17) Special conditions for safe use

None

We confirm the correctness of the translation from the German original.
In the case of arbitration only the German wording shall be valid and binding.

DEKRA EXAM GmbH
44809 Bochum, 10.05.2012
BVS-Kr/Ar A 20110041

Certification body

Special services unit



(1)

EG- Baumusterprüfbescheinigung

(2)

**Geräte und Schutzsysteme zur bestimmungsgemäßen Verwendung
in explosionsgefährdeten Bereichen**

(3)

BVS 06 ATEX E 088

(4) **Gerät:** Überdruckkapselungssystem Typ F 850 S und F 860 S

(5) **Hersteller:** Gönnheimer Elektronic GmbH

(6) **Anschrift:** D- 67433 Neustadt an der Weinstraße

(7) Die Bauart dieses Gerätes sowie die verschiedenen zulässigen Ausführungen sind in der Anlage zu dieser Baumusterprüfbescheinigung festgelegt.

(8) Die Zertifizierungsstelle der EXAM BBG Prüf- und Zertifizier GmbH, benannte Stelle Nr. 0158 gemäß Artikel 9 der Richtlinie 94/9/EG des Europäischen Parlaments und des Rates vom 23. März 1994, bescheinigt, dass das Gerät die grundlegenden Sicherheits- und Gesundheitsanforderungen für die Konzeption und den Bau von Geräten und Schutzsystemen zur bestimmungsgemäßen Verwendung in explosionsgefährdeten Bereichen gemäß Anhang 11 der Richtlinie erfüllt.

Die Ergebnisse der Prüfung sind in dem Prüfprotokoll BVS PP 06.2078 EG niedergelegt.

(9) Die grundlegenden Sicherheits- und Gesundheitsanforderungen werden erfüllt durch Übereinstimmung mit

EN 60079-0:2004	Allgemeine Bestimmungen	EN 60079-2:2004	Überdruckkapselung 'p'
EN 60079-7:2003	Erhöhte Sicherheit 'e'	FDIS IEC 60079-11 :2005	Eigensicherheit 'i'
EN 60079-18 :2004	Vergusskapselung 'm'	IEC 61241-0:2004	Allgemeine
EN 61241-1 :2004	Bestimmungen		
EN 954-1:1996	Schutz durch Gehäuse ,tD' Betriebsmittel	IEC 61241-11:2005	Eigensichere Sicherheit von Maschinen, Sicherheitsbezogene Teile von Steuerungen

(10) Falls das Zeichen "X" hinter der Bescheinigungsnummer steht, wird in der Anlage zu dieser Bescheinigung auf besondere Bedingungen für die sichere Anwendung des Gerätes hingewiesen.

(11) Diese EG-Baumusterprüfbescheinigung bezieht sich nur auf die Konzeption und die Baumusterprüfung des beschriebenen Gerätes in Übereinstimmung mit der Richtlinie 94/9/EG.

Für Herstellung und in Verkehr bringen des Gerätes sind weitere Anforderungen der Richtlinie zu erfüllen, die nicht durch diese Bescheinigung abgedeckt sind.

(12) Die Kennzeichnung des Gerätes muss die folgenden Angaben enthalten:

 **II 2 G für FS850S, FS860S und BT851**

II 2 D für FS850S und BT851

Details siehe 15.1

EXAM BBG- Prüf- und Zertifizier GmbH

Bochum, den 25. Juli 2006

Aligenda

Zertifizierungsstelle

Arndt

Fachbereich



(13)

Anlage zur

(14)

EG-Baumusterprüfbescheinigung

BVS 06 ATEX E 088

(15) 15.1 Gegenstand und Typ

Überdruckkapselungssystem Typ F 850 S und F 860 S

Steuergerät Typ FS850S:

 II 2G Ex e mb [ib] [px] IIC T6	-20 °C ≤ T _A ≤ +45 °C
 II 2G Ex e mb [ib] [px] IIC T4	-20 °C ≤ T _A ≤ +60 °C
II 2D Ex tD [ibD] [pD] A21 IP 65 T 70 °C	-20 °C ≤ T _A ≤ +60 °C

Steuergerät Typ FS850S.*.*.HT:

 II 2G Ex e mb [ib] [px] IIC T4	-20 °C ≤ T _A ≤ +70 °C
--	----------------------------------

Steuergerät Typ FS860S:

 II 2G Ex e mb [ib] [px] IIC T6	-20 °C ≤ T _A ≤ +45 °C
 II 2G Ex e mb [ib] [px] IIC T4	-20 °C ≤ T _A ≤ +60 °C

Bedientableau BT851:

 II 2G Ex ib IIC T6
II 2D Ex ibD 21 T 80 °C

15.2 Beschreibung

Die Überdruckkapselungssysteme Typ F850S und Typ F860S dienen zum Aufbau von explosionsgeschützten elektrischen Betriebsmitteln in der Zündschutzart Überdruckkapselung nach EN/IEC 60079-2 sowie EN/IEC 61241-4. Sie bestehen aus den Steuergeräten FS 850 S bzw. FS 860 S sowie dem Bedientableau BT 851 sowie weiteren Zusatzgeräten.

Die Funktionssicherheit des Überdruckkapselungssystems Typ F 850 S wurde auf Grundlage der EN 954 "Sicherheit von Maschinen- Sicherheitsbezogene Teile von Steuerungen" geprüft, es entspricht der Kategorie 3 der genannten Norm.

15.3 Kenngrößen

Netzanschluss
(Klemmen 15 bis 18) 230,220, 120, 110,24 V AC, bzw. 24 V DC
Sicherheitstechnischer Maximalwert Um = 253 V

Ventilsicherung
(Klemmen 25/26) zugehörige Ventilsicherung Typ SI850

Ventilanschlüsse
(Klemmen 21/22 und 23/24) Höhe der Spannung wie Netzanschluss

Proportionalventilanschluss
(Klemmen 19/20) Höhe der Spannung wie Netzanschluss

Kontaktstromkreise (Klemmen 11/12 und 13/14)	Wechselspannung U = 250 V	Gleichspannung U = 30 V
	I = 5 A	I = 5 A
	cos φ = 0,7	P = 150 W



Eigensichere Anschlüsse

in Zündschutzart Eigensicherheit Ex ib IIC

Die Höchstwerte, die höchstzulässigen Werte für die äußereren Reaktanzen sowie die zugehörigen Klemmenbezeichnungen sind folgender Tabelle zu entnehmen:

Klemme	U ₀	I ₀	P ₀	L ₀	C ₀
1,9	8,61 V	51 mA	110 mW	10 mH	2 µH
4	8,61 V	10 mA	22 mW	10 mH	2 µH
3	8,61 V	20 mA	44 mW	10 mH	2 µH
5, 6, 10	8,61 V	6 mA	13 mW		
2	Masseanschluss der Stromkreise				

Die eigensicheren Stromkreise (Klemmen 1 bis 10) sind von allen anderen Stromkreisen bis zu einem Scheitelwert der Nennspannung von 375 V sicher galvanisch getrennt.

Der zulässige Umgebungstemperaturbereich beträgt für die Temperaturklasse T6: -20°C bis 45 °C und für T4: - 20° C bis 60 °C.

Für das Steuergerät Typ FS850S.*.*.HT (nur Temperaturklasse T4) beträgt der zulässige Umgebungstemperaturbereich: -20°C bis 70°C.

(16) Prüfprotokoll

BVS PP 06.2078 EG, Stand 25.07.2006

(17) Besondere Bedingungen für die sichere Anwendung

keine



1. Nachtrag

(Ergänzung gemäß Richtlinie 94/9/EG Anhang III Ziffer 6))

zur EG-Baumusterprüfbescheinigung BVS 06 ATEX E 088

Gerät: Überdruckkapselungssystem Typ F 850 S und F 860 S

Hersteller: Gönnheimer Elektronic GmbH

Anschrift: D- 67433 Neustadt an der Weinstraße

Beschreibung:

Die Steuergeräte des Überdruckkapselungssystems können auch nach den im zugehörigen Prüfprotokoll aufgeführten Prüfungsunterlagen gefertigt werden.

Die grundlegenden Sicherheits- und Gesundheitsanforderungen der geänderten Ausführung werden erfüllt durch Übereinstimmung mit:

EN 60079-0:2004	Allgemeine Bestimmungen	EN 60079-2:2004	Überdruckkapselung 'p'
EN 60079-7:2003	Erhöhte Sicherheit 'e'	IEC 60079-11 :2006	Eigensicherheit 'i'
EN 60079-18 :2004	Vergusskapselung 'm'	IEC 61241-0:2004	Allgemeine Bestimmungen
EN 61241-1 :2004	Schutz durch Gehäuse ,tD'	IEC 61241-11:2005	Eigensichere Betriebsmittel
EN 954-1:1996	Sicherheit von Maschinen, Sicherheitsbezogene Teile von Steuerungen		

Die Kennzeichnung des Gerätes muss die folgenden Angaben enthalten:

Für Typ FS850S
II 2G Ex e mb [ib] [px] IIC T6 or
II 2G Ex e mb [ib] [px] IIC T4 and
II 2D Ex tD [ibD] [pD] A21 IP65 T 70°C



Für Typ FS850S.*.*.*.HT
II 2G Ex e mb [ib] [px] IIC T4 and

Type FS860S

II 2G Ex e mb [ib] [px] IIC T6 or
II 2G Ex e mb [ib] [px] IIC T4

Für Typ BT851
II 2G Ex ib IIC T6 and
II 2D Ex ibD 21 T 80°C




Prüfprotokoll:

BVS PP 06.2078 EG, Stand 23.10.2006

EXAM BBG Prüf- und Zertifizier GmbH

Bochum, den 23. Oktober 2006



Zertifizierungsstelle



Fachbereich



2. Nachtrag

(Ergänzung gemäß Richtlinie 94/9/EG Anhang III Ziffer 6)

zur EG-Baumusterprüfbescheinigung BVS 06 ATEX E 088

Gerät: Überdruckkapselungssystem Typ F 850 S und F 860 S
Hersteller: Gönnheimer Elektronic GmbH
Anschrift: D- 67433 Neustadt an der Weinstraße

Beschreibung:

Das Überdruckkapselungssystem wird ergänzt um die Steuergeräte

FS850S.*.*. BY1,2

FS850S.*.*., BY1,5

FS850S.*.*.HT.BY1,2

FS850S.**.*.HT. BY1,5

bei denen durch eine zusätzliche Durchflussdüse im Druckwächtermodul eine ständige Durchspülung erreicht wird, die durch die Überwachung des Mindest-Überdrucks mit überwacht wird.

Die grundlegenden Sicherheits- und Gesundheitsanforderungen der geänderten Ausführung werden erfüllt durch Übereinstimmung mit

EN 60079-0:2006	Allgemeine Bestimmungen
EN 60079-2:2004	Überdruckkapselung 'p'
EN 60079-7:2003	Erhöhte Sicherheit 'e'
EN 60079-11 :2007	Eigensicherheit 'i'
EN 60079-18:2004	Vergusskapselung 'm'
EN 954-1 :1996	Sicherheit von Maschinen, Sicherheitsbezogene Teile von Steuerungen Allgemeine Gestaltungsgrundsätze
EN 61241-0:2006	Allgemeine Bestimmungen
EN 61241-1:2004	Schutz durch Gehäuse 'tD'
IEC 61241-11:2005	Eigensichere Betriebsmittel 'iD'

Die Kennzeichnung des Gerätes ist unverändert

Kenngrößen

Alle elektrischen Kenngrößen sind unverändert.

Für die hinzugekommenen Steuergeräte gilt folgende ständige Durchflussmenge in Abhängigkeit vom überwachten Mindest-Überdruck:



Mindest-Überdruck	Ständige Durchflussmenge	
	FS850S....BY1,2	FS850SBY1,5
80 Pa	0,013 l/s	0,020 l/s
100 Pa	0,014 l/s	0,022 l/s
200 Pa	0,020 l/s	0,031 l/s
400 Pa	0,028 l/s	0,044 l/s
600 Pa	0,034 l/s	0,054 l/s
800 Pa	0,040 l/s	0,062 l/s
1000 Pa	0,044 l/s	0,070 l/s

Besondere Bedingungen für die sichere Anwendung bzw. Verwendungshinweise

Keine

Prüfprotokoll:

BVS PP 06.2078 EG, Stand 29.05.2007

DEKRA EXAM GmbH

Bochum, den 29. Mai 2007

Zertifizierungsstelle

Fachbereich

(1) 3. Nachtrag zur EG-Baumusterprüfbescheinigung

- (2) Geräte und Schutzsysteme zur bestimmungsgemäßen Verwendung in explosionsgefährdeten Bereichen - Richtlinie 94/9/EG
Ergänzung gemäß Anhang III Ziffer 6
- (3) Nr. der EG-Baumusterprüfbescheinigung: **BVS 06 ATEX E 088**
- (4) Gerät: **Überdruckkapselungssystem Typ F 850S und F 860S**
- (5) Hersteller: **Gönnheimer Elektronic GmbH**
- (6) Anschrift: **67405 Neustadt an der Weinstraße**
- (7) Die Bauart dieser Geräte sowie die verschiedenen zulässigen Ausführungen sind in der Anlage zu diesem Nachtrag festgelegt.
- (8) Die Zertifizierungsstelle der DEKRA EXAM GmbH, benannte Stelle Nr. 0158 gemäß Artikel 9 der Richtlinie 94/9/EG des Europäischen Parlaments und des Rates vom 23. März 1994, bescheinigt, dass diese Geräte die grundlegenden Sicherheits- und Gesundheitsanforderungen für die Konzeption und den Bau von Geräten und Schutzsystemen zur bestimmungsgemäßen Verwendung in explosionsgefährdeten Bereichen gemäß Anhang II der Richtlinie erfüllen. Die Ergebnisse der Prüfung sind in dem Prüfprotokoll BVS PP 06.2078 EG niedergelegt.
- (9) Die grundlegenden Sicherheits- und Gesundheitsanforderungen werden erfüllt durch Übereinstimmung mit
IEC 60079-0:2011 Allgemeine Anforderungen
EN 60079-2:2007 Überdruckkapselung 'p'
EN 60079-7:2007 Erhöhte Sicherheit 'e'
EN 60079-11:2012 Eigensicherheit 'i'
EN 60079-18:2009 Vergusskapselung 'm'
EN 60079-31:2009 Schutz durch Gehäuse 't'
EN 50495:2010 Sicherheitseinrichtungen für den sicheren Betrieb von Geräten im Hinblick auf Explosionsgefahren
- (10) Falls das Zeichen "X" hinter der Bescheinigungsnummer steht, wird in der Anlage zu dieser Bescheinigung auf besondere Bedingungen für die sichere Anwendung des Gerätes hingewiesen.
- (11) Dieser Nachtrag zur EG-Baumusterprüfbescheinigung bezieht sich nur auf die Konzeption und die Baumusterprüfung der beschriebenen Geräte in Übereinstimmung mit der Richtlinie 94/9/EG. Für Herstellung und Inverkehrbringen der Geräte sind weitere Anforderungen der Richtlinie zu erfüllen, die nicht durch diese Bescheinigung abgedeckt sind.
- (12) Die Kennzeichnung des Gerätes muss die folgenden Angaben enthalten:



II 2G siehe Abs. 15.1
II 2D siehe Abs. 15.1

DEKRA EXAM GmbH
Bochum, den 10. Mai 2012

Zertifizierungsstelle

Fachbereich

(13) Anlage zum

**(14) 3. Nachtrag zur EG-Baumusterprüfbescheinigung
BVS 06 ATEX E 088**

(15) 15.1 Gegenstand und Typ

Überdruckkapselungssysteme Typ F850S.*.*.*., Typ F850S.*.*.*.BY1,*., Typ F860S.*.*.*. und Typ F860S.*.*.*.BY1,*.

Die Kennzeichnung der Geräte muss die folgenden Angaben enthalten:
Steuergerät Typ FS850S.*.*.* und Typ FS850S.*.*.*.BY1,*:

	Alternativ		
Ex II 2G Ex e mb [ib] [px] IIC T6 Gb	Ex eb mb [ib] [pxb] IIC T6	-20 °C ≤ TA ≤ +45 °C	
Ex II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20 °C ≤ TA ≤ +60 °C	
II 2D Ex tb [ib] [p] IIIC T 70 °C Db IP 65	Ex tb [ib] [pb] IIIC T 70 °C IP 65	-20 °C ≤ TA ≤ +60 °C	

Steuergerät Typ FS850S.*.*.*.HT und Typ FS850S.*.*.*.HT.BY1,*:

Ex II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20 °C ≤ TA ≤ +70 °C
--------------------------------------	----------------------------	----------------------

Steuergerät Typ FS860S.*.*.* und Typ FS860S.*.*.*.BY1,*:

Ex II 2G Ex e mb [ib] [px] IIC T6 Gb	Ex eb mb [ib] [pxb] IIC T6	-20 °C ≤ TA ≤ +45 °C
Ex II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20 °C ≤ TA ≤ +60 °C

Bedientableau BT 851:

Ex II 2G Ex ib IIC T6 Gb	Ex ib IIC T6
II 2D Ex ib IIIC T 80 °C Db	Ex ib IIIC T 80 °C

15.2 Beschreibung

Die Schaltung der Steuergeräte kann auch nach den im zugehörigen Prüfprotokoll aufgeführten Prüfungsunterlagen gefertigt werden; Grund des Nachtrags ist auch die Anhebung auf den aktuellen Normenstand. Daraus resultiert eine geänderte Kennzeichnung.

Die Überdruckkapselungssysteme Typ F 850 S und F 860 S wurden auf der Grundlage

EN 50495: 2010 "Sicherheitseinrichtungen für den sicheren Betrieb von Geräten im Hinblick auf Explosionsgefahren" geprüft. Die Systeme sind im Rahmen ihrer Funktionalität zur Verwendung in Sicherheitsfunktionen bis zu einem Sicherheitsintegritätslevel von SIL 2 geeignet. Dies gilt für den für den „high demand mode of operation“. Berücksichtigt wurde hierbei der Software Version Stand 3.1.x vom 22.11.2005. Die Anforderungen an die Gerätekategorie 3 hinsichtlich Einfachersicherheit werden erfüllt. Dieses entspricht einer Hardware Fehlertoleranz HFT = 1.

15.3 Kenngrößen

Alle Kenngrößen sind unverändert.

(16) Prüfprotokoll

BVS PP 06.2078 EG, Stand 10.05.2012

(17) Besondere Bedingungen für die sichere Anwendung

Keine

(1) 4. Nachtrag zur EG-Baumusterprüfbescheinigung

- (2) Geräte und Schutzsysteme zur bestimmungsgemäßen Verwendung in explosionsgefährdeten Bereichen - Richtlinie 94/9/EG
Ergänzung gemäß Anhang III Ziffer 6
- (3) Nr. der EG-Baumusterprüfbescheinigung: **BVS 06 ATEX E 088**
- (4) Gerät: **Überdruckkapselungssystem Typ FS850S und FS860S**
- (5) Hersteller: **Gönnheimer Elektronic GmbH**
- (6) Anschrift: **Dr.-Julius-Leber-Str. 2, 67433 Neustadt an der Weinstraße**
- (7) Die Bauart dieser Geräte sowie die verschiedenen zulässigen Ausführungen sind in der Anlage zu diesem Nachtrag festgelegt.
- (8) Die Zertifizierungsstelle der DEKRA EXAM GmbH, benannte Stelle Nr. 0158 gemäß Artikel 9 der Richtlinie 94/9/EG des Europäischen Parlaments und des Rates vom 23. März 1994, bescheinigt, dass diese Geräte die grundlegenden Sicherheits- und Gesundheitsanforderungen für die Konzeption und den Bau von Geräten und Schutzsystemen zur bestimmungsgemäßen Verwendung in explosionsgefährdeten Bereichen gemäß Anhang II der Richtlinie erfüllen. Die Ergebnisse der Prüfung sind in dem Prüfprotokoll BVS PP 06.2078 EG niedergelegt.
- (9) Die grundlegenden Sicherheits- und Gesundheitsanforderungen werden erfüllt durch Übereinstimmung mit
- EN 60079-0:2012 Allgemeine Anforderungen
EN 60079-2:2007 Überdruckkapselung 'p'
EN 60079-7:2007 Erhöhte Sicherheit 'e'
EN 60079-11:2012 Eigensicherheit 'i'
EN 60079-18:2009 Vergusskapselung 'm'
EN 60079-31:2009 Schutz durch Gehäuse 't'
EN 50495:2010 Sicherheitseinrichtungen für den sicheren Betrieb von Geräten im Hinblick auf Explosionsgefahren
- (10) Falls das Zeichen "X" hinter der Bescheinigungsnummer steht, wird in der Anlage zu dieser Bescheinigung auf besondere Bedingungen für die sichere Anwendung des Gerätes hingewiesen.
- (11) Dieser Nachtrag zur EG-Baumusterprüfbescheinigung bezieht sich nur auf die Konzeption und die Baumusterprüfung der beschriebenen Geräte in Übereinstimmung mit der Richtlinie 94/9/EG. Für Herstellung und Inverkehrbringen der Geräte sind weitere Anforderungen der Richtlinie zu erfüllen, die nicht durch diese Bescheinigung abgedeckt sind.
- (12) Die Kennzeichnung des Gerätes muss die folgenden Angaben enthalten:



**II 2G siehe Abs. 15.1
II 2D siehe Abs. 15.1**

DEKRA EXAM GmbH
Bochum, den 30.01.2014

Zertifizierungsstelle

Fachbereich

- (13) Anlage zum
 (14) **4. Nachtrag zur EG-Baumusterprüfbescheinigung
BVS 06 ATEX E 088**
 (15) 15.1 Gegenstand und Typ

Überdruckkapselungssysteme Typ F850S.*.*., Typ F850S.*.*.BY1,*., Typ F860S.*.*. und Typ F860S.*.*.BY1,*.

Die Kennzeichnung der Geräte muss die folgenden Angaben enthalten:
 Steuergerät Typ FS850S.*.*. und Typ FS850S.*.*.BY1,*.

	Alternativ	
II 2G Ex e mb [ib] [px] IIC T6 Gb	Ex eb mb [ib] [pxb] IIC T6	-20°C ≤ T _A ≤ +45°C
Ex II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20°C ≤ T _A ≤ +60°C
II 2D Ex tb [ib] [p] IIIC T 70°C Db IP 65	Ex tb [ib] [pb] IIIC T 70°C IP 65	-20°C ≤ T _A ≤ +60°C

Steuergerät Typ FS850S.*.*.HT und Typ FS850S.*.*.HT.BY1,*.

Ex II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20°C ≤ T _A ≤ +70°C
--------------------------------------	----------------------------	--------------------------------

Steuergerät Typ FS860S.*.*. und Typ FS860S.*.*.BY1,*.

Ex II 2G Ex e mb [ib] [px] IIC T6 Gb	Ex eb mb [ib] [pxb] IIC T6	-20°C ≤ T _A ≤ +45°C
II 2G Ex e mb [ib] [px] IIC T4 Gb	Ex eb mb [ib] [pxb] IIC T4	-20°C ≤ T _A ≤ +60°C

Bedientableau BT 851:

II 2G Ex ib IIC T6 Gb	Ex ib IIC T6
Ex II 2D Ex ib IIIC T 80°C Db	Ex ib IIIC T 80°C

15.2 Beschreibung

Die Geräte des Überdruckkapselungssystems können auch nach den im zugehörigen Prüfprotokoll aufgeführten Prüfungsunterlagen gefertigt werden. Die Schaltung der Steuergeräte und des zugehörigen Bedientableaus wird geringfügig geändert; außerdem wurden die Geräte auf der Grundlage der aktuellen Normenfassungen EN 60079-* und EN 50495:2010 geprüft.

Hardware und die Software haben sich geändert.

Dadurch werden die Überdruckkapselungssysteme Typ F 850 S und F 860 S auf Grundlage der EN 50495: 2010 "Sicherheitseinrichtungen für den sicheren Betrieb von Geräten im Hinblick auf Explosionsgefahren" neu geprüft. Die Systeme sind im Rahmen ihrer Funktionalität zur Verwendung in Sicherheitsfunktionen bis zu einem Sicherheitsintegritätslevel von SIL 2 geeignet. Dies gilt für den für den „high demand mode of operation“. Berücksichtigt wurde hierbei der Software Version Stand 4.0.0. Die Anforderungen an die Gerätetypenklasse 3 hinsichtlich Einfachsicherheit werden erfüllt. Dieses entspricht einer Hardware Fehlertoleranz HFT = 1.

15.3 Kenngrößen

Netzanschluss (Klemmen 15 bis 18)	230, 220, 120, 110, 24 V AC, bzw. 24 V DC Sicherheitstechnischer Maximalwert Um = 253 V		
Ventilsicherung (Klemmen 25/26)	zugehörige Ventilsicherung Typ SI850		
Ventilanschlüsse (Klemmen 21/22 und 23/24)	Höhe der Spannung wie Netzanschluss		
Proportionalventilanschluss (Klemmen 19/20)	Höhe der Spannung wie Netzanschluss		
Kontaktstromkreise (Klemmen 11/12 und 13/14)	Wechselspannung U = 250 V	Gleichspannung U = 30 V	
	I = 5 A	I = 5 A	
	cosφ = 0,7	P = 150 W	

Eigensichere Anschlüsse

in Zündschutzart Eigensicherheit Ex ib IIC

Die Höchstwerte, die höchstzulässigen Werte für die äußereren Reaktanzen sowie die zugehörigen Klemmenbezeichnungen sind folgender Tabelle zu entnehmen:

Klemme	U_0	I_0	P_0	L_0	C_0
1, 9	8,61 V	51 mA	110 mW	10 mH	2 μ F
4	8,61 V	10 mA	22 mW	10 mH	2 μ F
3	8,61 V	20 mA	44 mW	10 mH	2 μ F
5, 6, 10	8,61 V	6 mA	13 mW	10 mH	2 μ F
7, 8	8,61 V	10 mA	22 mW	10 mH	2 μ F
2	Masseanschluss der Stromkreise				

Die eigensicheren Stromkreise (Klemmen 1 bis 10) sind von allen anderen Stromkreisen bis zu einem Scheitelwert der Nennspannung von 375 V sicher galvanisch getrennt.

Der zulässige Umgebungstemperaturbereich beträgt für die Temperaturklasse T6: -20 °C bis 45 °C und für T4: -20 °C bis 60 °C.

Für das Steuergerät Typ FS850S.*.*.HT (nur Temperaturklasse T4) beträgt der zulässige Umgebungstemperaturbereich: -20 °C bis 70 °C.

Für die Steuergeräte gilt folgende ständige Durchflussmenge in Abhängigkeit vom überwachten Mindest-Überdruck:

Mindest-Überdruck	Ständige Durchflussmenge	
	FS850S... .BY1,2	FS850S... .BY1,5
80 Pa	0,013 l/s	0,020 l/s
100 Pa	0,014 l/s	0,022 l/s
200 Pa	0,020 l/s	0,031 l/s
400 Pa	0,028 l/s	0,044 l/s
600 Pa	0,034 l/s	0,054 l/s
800 Pa	0,040 l/s	0,062 l/s
1000 Pa	0,044 l/s	0,070 l/s

(16) Prüfprotokoll

BVS PP 06.2078 EG, Stand 30.01.2014

(17) Besondere Bedingungen für die sichere Anwendung

Keine